

## COMPREHENSIVE SERVICES

We offer competitive repair and calibration services, as well as easily accessible documentation and free downloadable resources.

## SELL YOUR SURPLUS

We buy new, used, decommissioned, and surplus parts from every NI series. We work out the best solution to suit your individual needs.

 Sell For Cash  Get Credit  Receive a Trade-In Deal

## OBSOLETE NI HARDWARE IN STOCK & READY TO SHIP

We stock **New**, **New Surplus**, **Refurbished**, and **Reconditioned** NI Hardware.



*Bridging the gap between the manufacturer and your legacy test system.*

 1-800-915-6216

 [www.apexwaves.com](http://www.apexwaves.com)

 [sales@apexwaves.com](mailto:sales@apexwaves.com)

*All trademarks, brands, and brand names are the property of their respective owners.*

**Request a Quote**

 **CLICK HERE**

**sbRIO-9612**



National Instruments sbRIO-9631 Manual  
Get Pricing & Availability at  
**ApexWaves.com**

Call Today: 1-800-915-6216  
Email: [sales@apexwaves.com](mailto:sales@apexwaves.com)

<https://www.apexwaves.com/modular-systems/national-instruments/compactrio-controllers/sbRIO-9631>

## USER GUIDE

# NI sbRIO-961x/963x/964x and NI sbRIO-9612XT/9632XT/9642XT

## Single-Board RIO OEM Devices

This document provides dimensions, pinouts, connectivity information, and specifications for the National Instruments sbRIO-9611, sbRIO-9612, sbRIO-9612XT, sbRIO-9631, sbRIO-9632, sbRIO-9632XT, sbRIO-9641, sbRIO-9642, and sbRIO-9642XT. The devices are referred to inclusively in this document as the NI sbRIO-961x/9612XT/963x/9632XT/964x/9642XT.



**Caution** The NI sbRIO-961x/9612XT/963x/9632XT/964x/9642XT must be installed inside a suitable enclosure prior to use. Hazardous voltages may be present.




**Caution** National Instruments makes no product safety, electromagnetic compatibility (EMC), or CE marking compliance claims for NI sbRIO devices. The end-product supplier is responsible for conformity to any and all compliance requirements.



**Caution** Exercise caution when placing the NI sbRIO devices inside an enclosure. Auxiliary cooling may be necessary to keep the device under the maximum ambient temperature rating for the NI sbRIO device. Refer to [Specifications](#) section for more information about the maximum ambient temperature rating.

Figure 1 shows the NI sbRIO-961x/9612XT/963x/9632XT and the NI sbRIO-964x/9642XT.

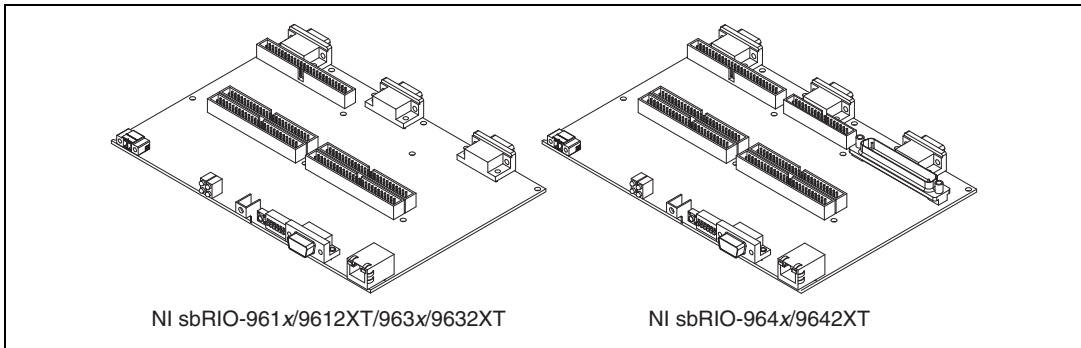

**Figure 1.** NI sbRIO-961x/9612XT/963x/9632XT and NI sbRIO-964x/9642XT

## What You Need to Get Started

---

This section lists the software and hardware you need to start programming the NI sbRIO device.

### Software Requirements

You need a development computer with the following software installed on it. Go to [ni.com/info](http://ni.com/info) and enter the Info Code `rdsoftwareversion` for information about software version compatibility.

- LabVIEW
- LabVIEW Real-Time Module
- LabVIEW FPGA Module
- NI-RIO

### Hardware Requirements

You need the following hardware to use the NI sbRIO device.

- NI sbRIO-961x/9612XT/963x/9632XT/964x/9642XT
- 19–30 VDC power supply
- Ethernet cable

# Dimensions


---

This section contains dimensional drawings of the NI sbRIO devices. For three-dimensional models, refer to the **Resources** tab of the NI sbRIO product page at [ni.com](http://ni.com).




**Note** The plated mounting holes are all connected to P1, the ground lug. Connect P1 or one of the plated mounting holes securely to earth ground. Refer to the [Understanding Ground Connections](#) section for cautions about current loops through the grounding lug.

Figure 2 shows the dimensions of the NI sbRIO-961x/9612XT/963x/9632XT/964x/9642XT.

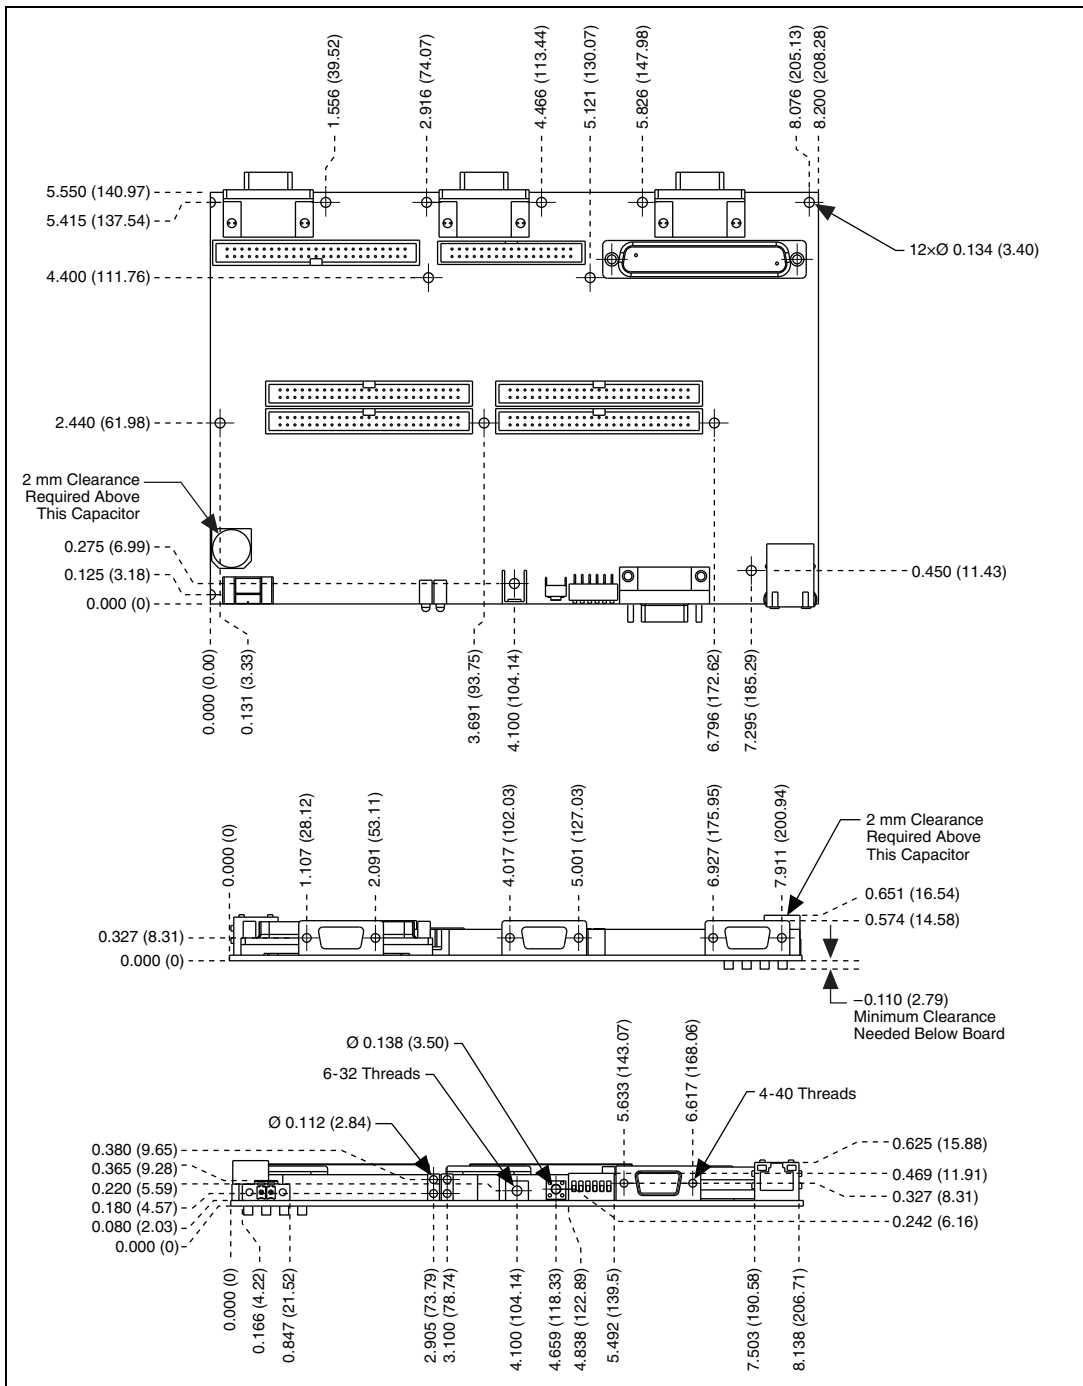

**Figure 2.** NI sbRIO-961x/9612XT/963x/9632XT/964x/9642XT  
Dimensions in Inches (Millimeters)

You can install up to three board-only C Series I/O modules on the NI sbRIO device. The following figure shows the dimensions of the NI sbRIO device with three board-only C Series I/O modules installed.

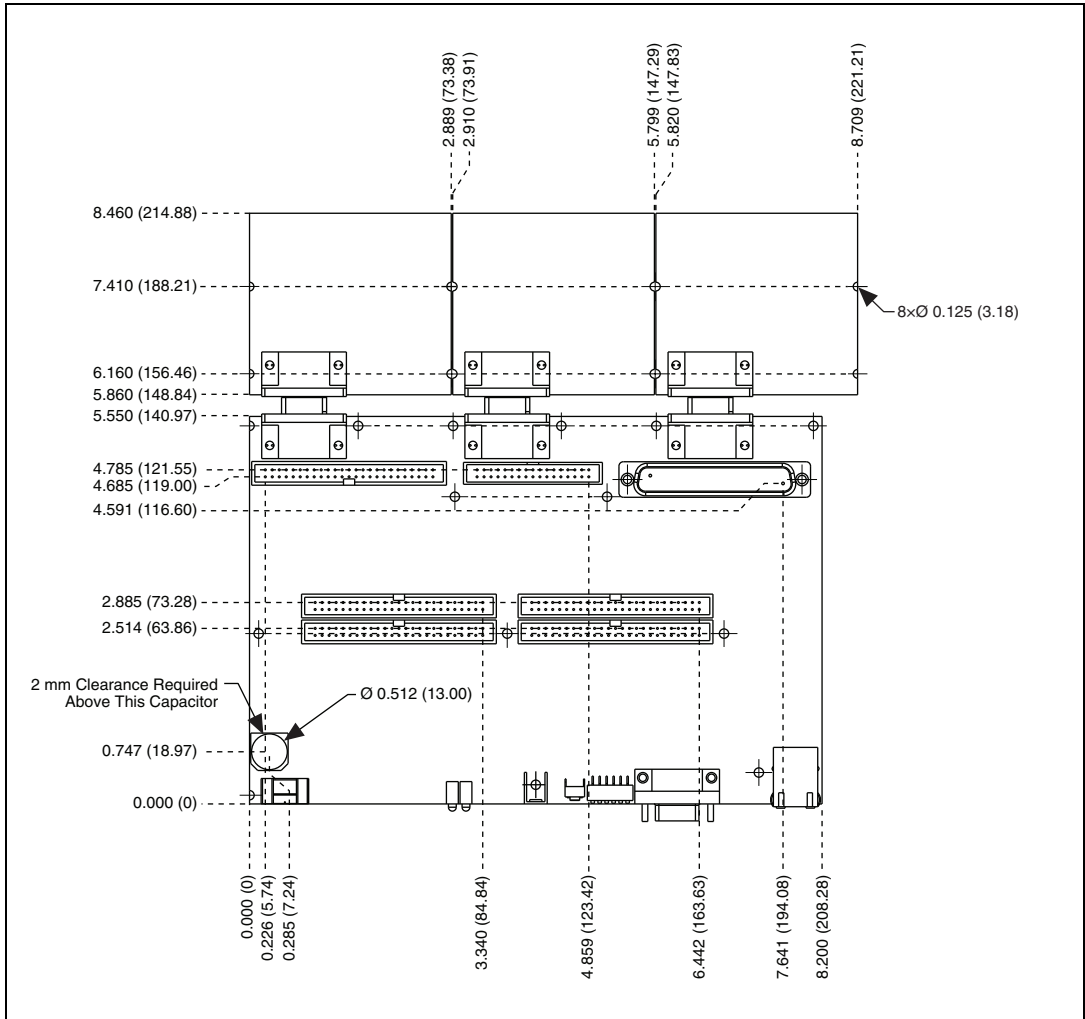


**Figure 3.** NI sbRIO-961x/9612XT/963x/9632XT/964x/9642XT with C Series Modules, Dimensions in Inches (Millimeters)



**Note** To maintain isolation clearances on the C Series modules, do not use mounting hardware larger than 0.240 in. (6.1 mm) in diameter and maintain an air gap of at least 0.200 in. (5.0 mm) from the modules to anything else.

# I/O and Other Connectors on the NI sbRIO Device

Figure 4 shows the locations of parts on the NI sbRIO device.

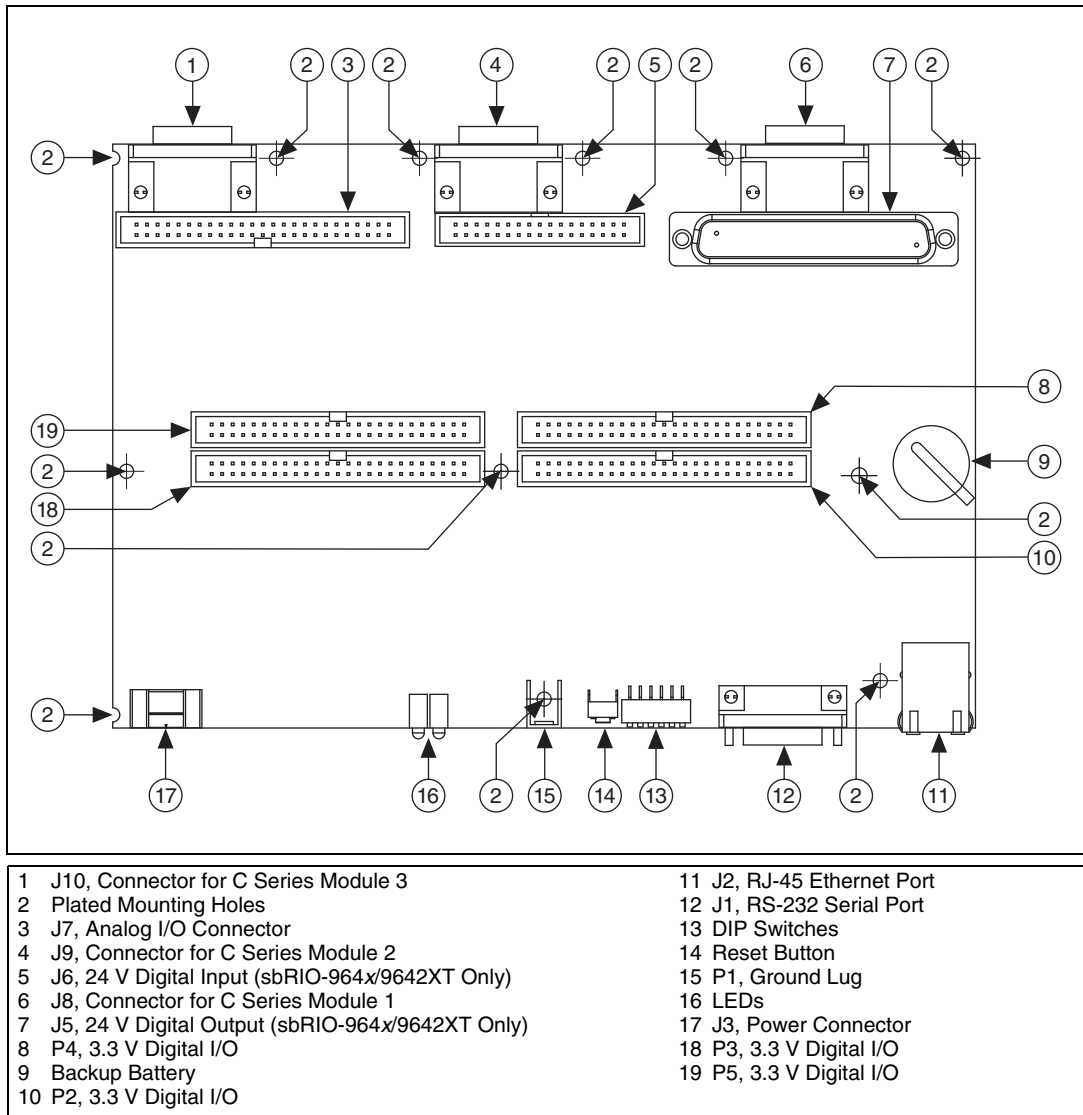

**Figure 4.** NI sbRIO Device Parts Locator Diagram

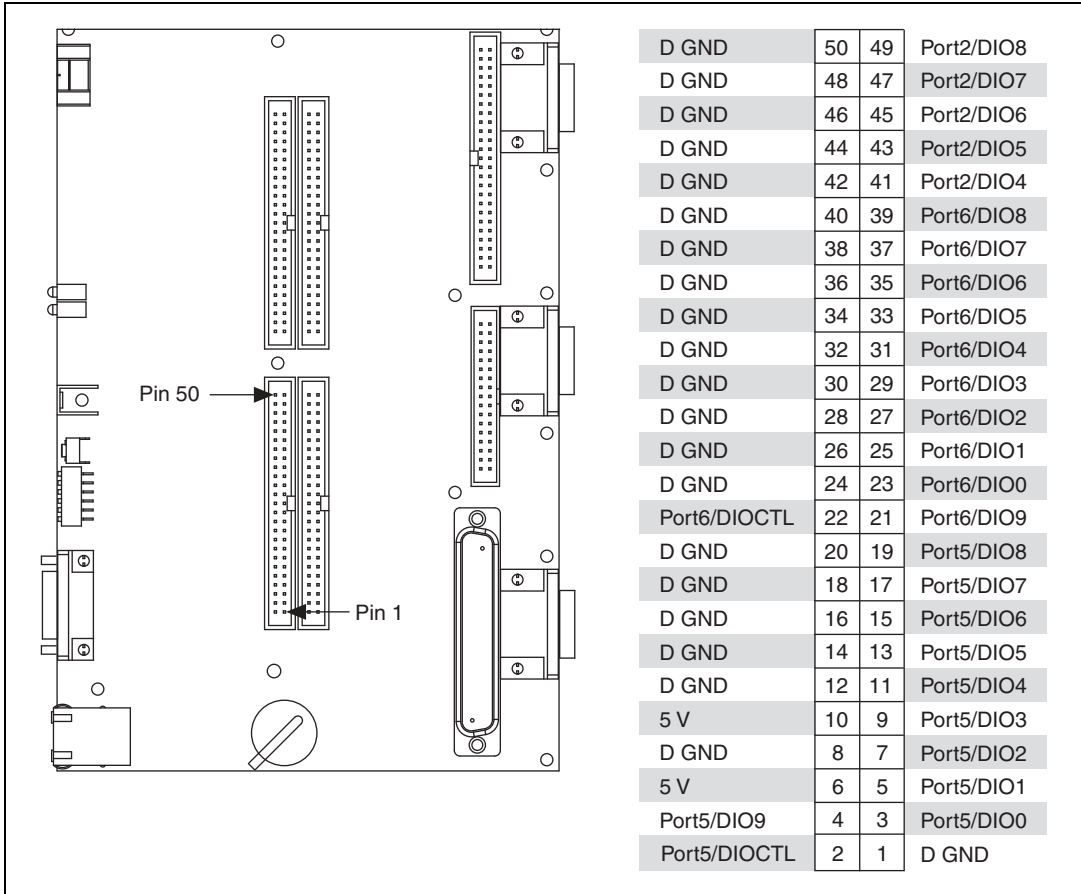


Table 1 lists and describes the connectors on NI sbRIO devices and lists the part number and manufacturer of each connector. Refer to the manufacturer for information about using and matching these connectors.


**Table 1.** NI sbRIO Connector Descriptions

Connector	Description	Manufacturer and Part Number	Recommended Mating Connector
J3, Power	2-position MINI-COMBICON header and plug, 0.285 in. (7.24 mm) high	Phoenix Contact, 1727566	Sauro, CTF02BV8-BN (included)
J1, RS-232 Serial Port	9-pin DSUB plug, 0.318 in. (8.08 mm) high, with 4-40 jacksockets	Tyco Electronics, 5747840-6	—
P2, P3, P4, P5, J7	50-pin polarized header plug, 0.100 × 0.100 in. (2.54 × 2.54 mm)	3M, N2550-6002RB	3M, 8550-4500PL*
J5	37-pin DSUB plug with 4-40 jacksockets	FCI, D37P24B6GV00LF	FCI, D37S24B6GV00
J6	34-pin polarized header plug, 0.100 × 0.100 in. (2.54 × 2.54 mm)	3M, N2534-6002RB	3M, 8534-4500PL†
<p>* (NI sbRIO-964x/9642XT Only) Use Samtec connector ESW-125-33-S-D if you are connecting one board to P2/P3/P4/P5/J7 and J5 to accommodate for the height of the J5 connector.</p> <p>† (NI sbRIO-964x/9642XT Only) Use Samtec connector ESW-117-33-S-D if you are connecting one board to J6 and J5 to accommodate for the height of the J5 connector.</p>			


The following figures show the pinouts of the I/O connectors on the NI sbRIO devices.




**Figure 5.** Pinout of I/O Connector P2, 3.3 V Digital I/O

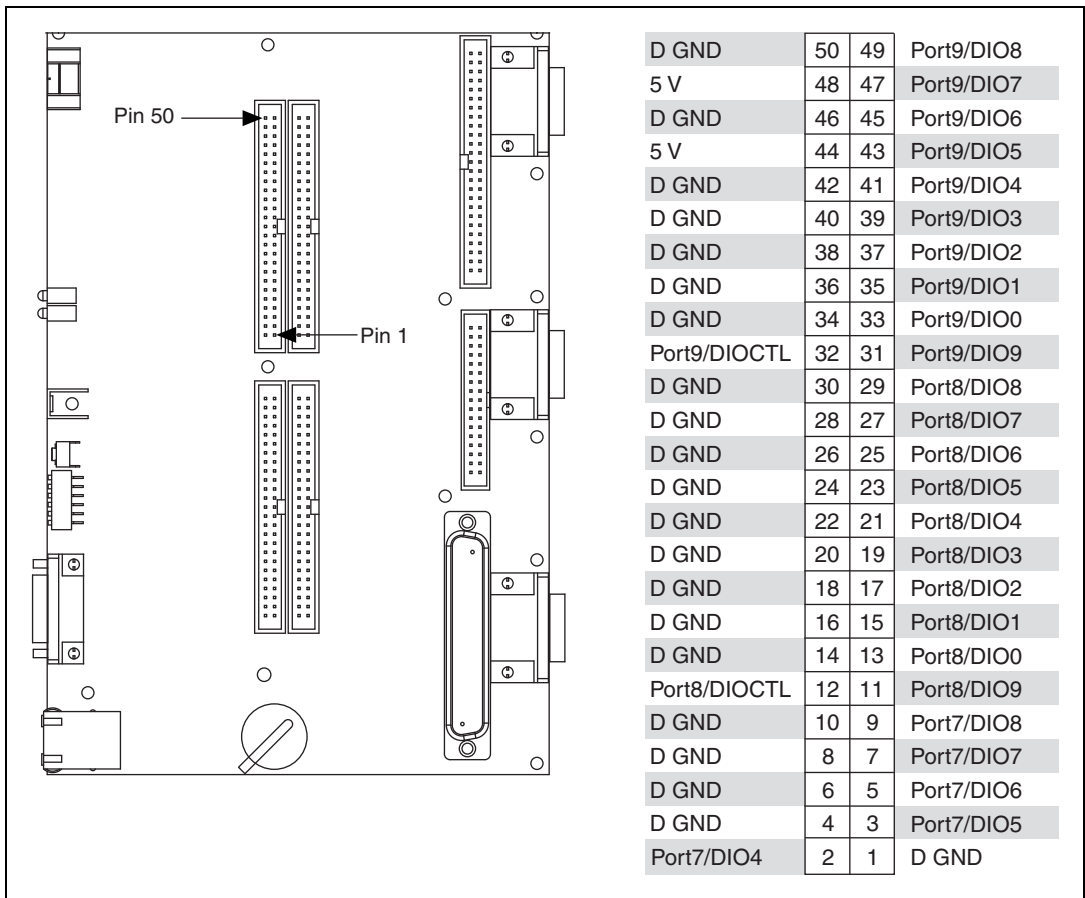


**Figure 6.** Pinout of I/O Connector P3, 3.3 V Digital I/O

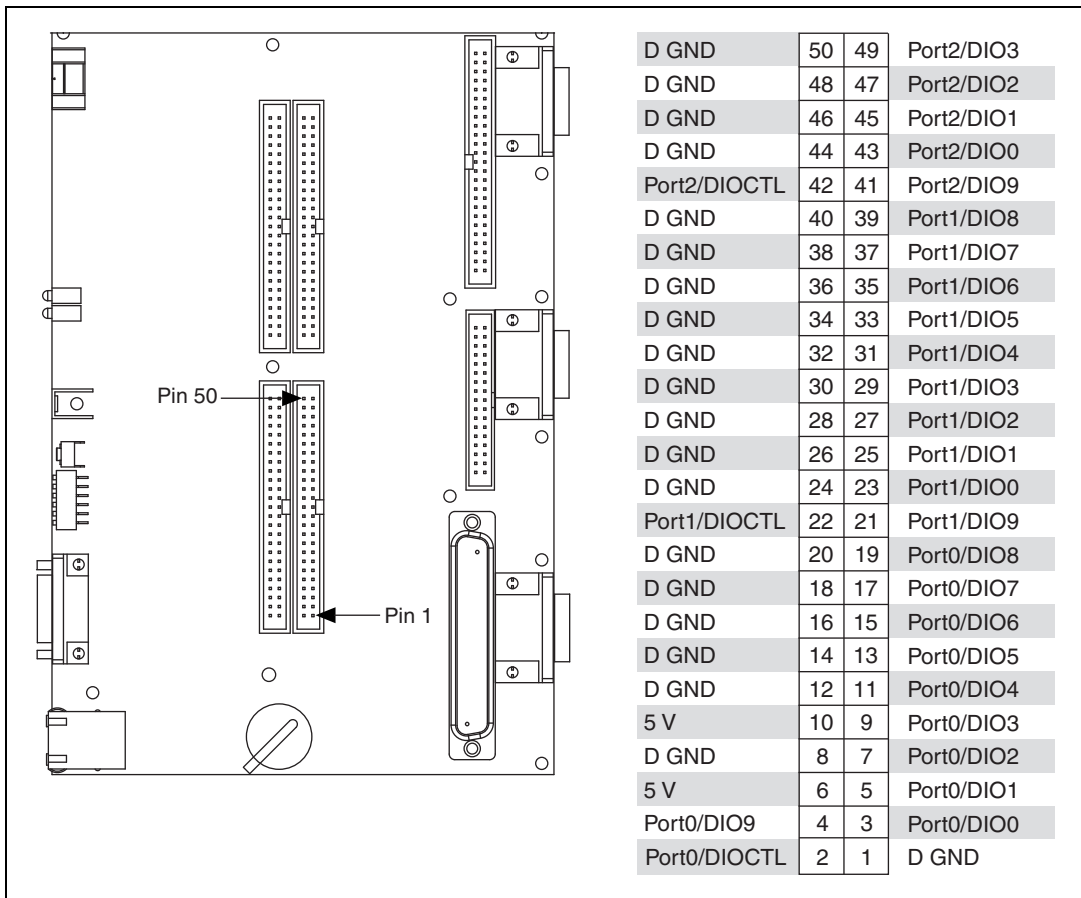


**Figure 7.** Pinout of I/O Connector P4, 3.3 V Digital I/O

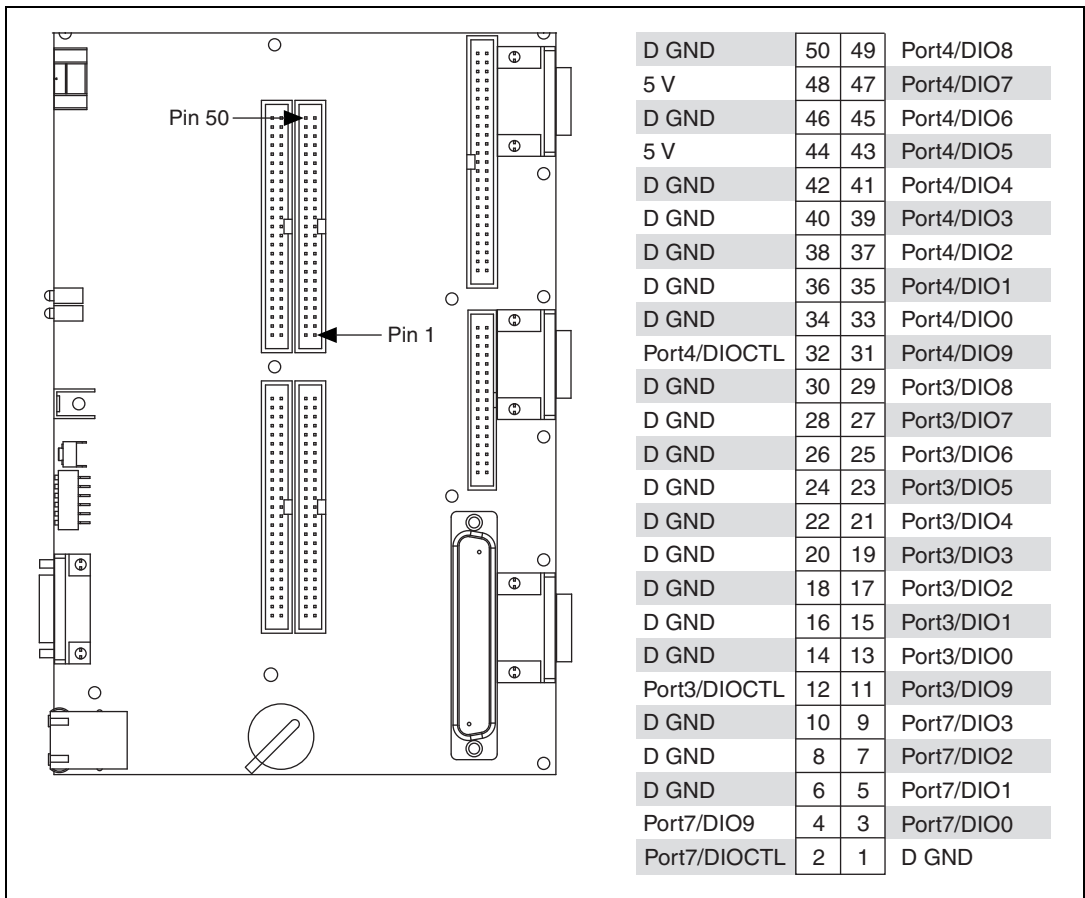


**Figure 8.** Pinout of I/O Connector P5, 3.3 V Digital I/O

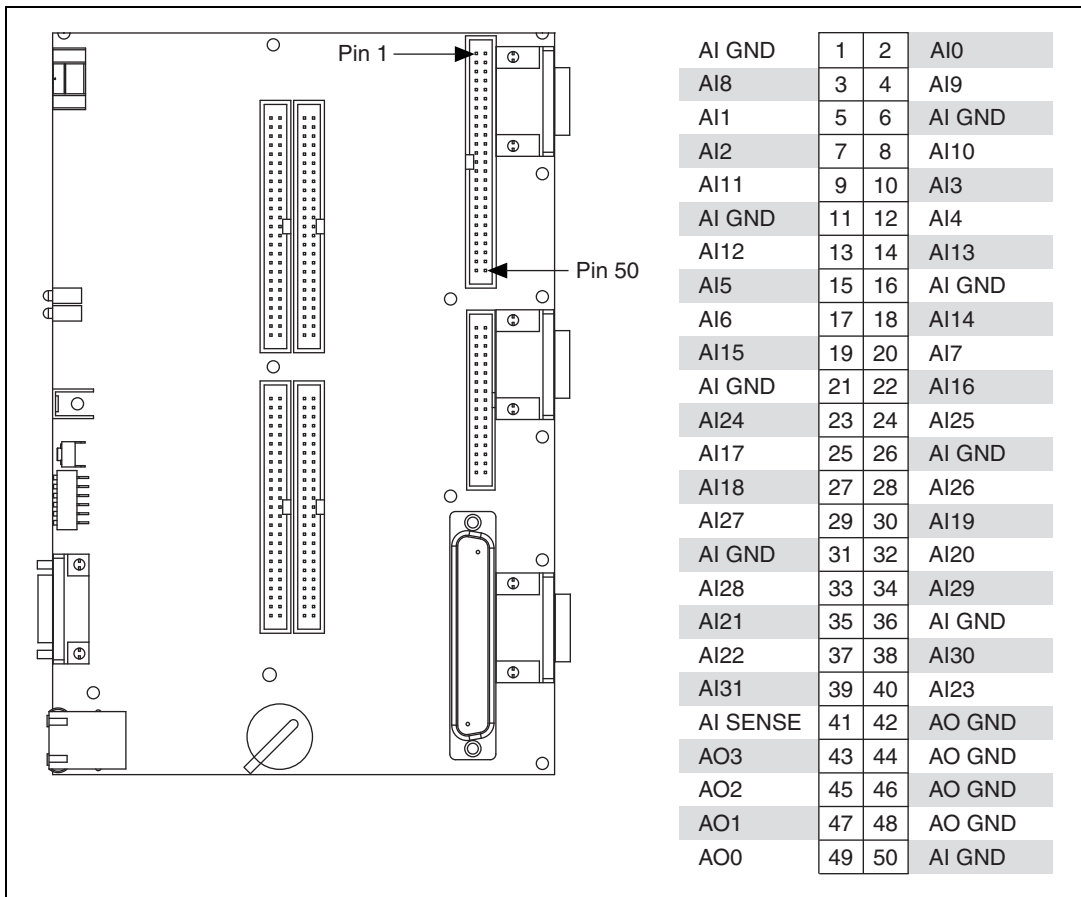

**Figure 9.** Pinout of I/O Connector J7, Analog I/O

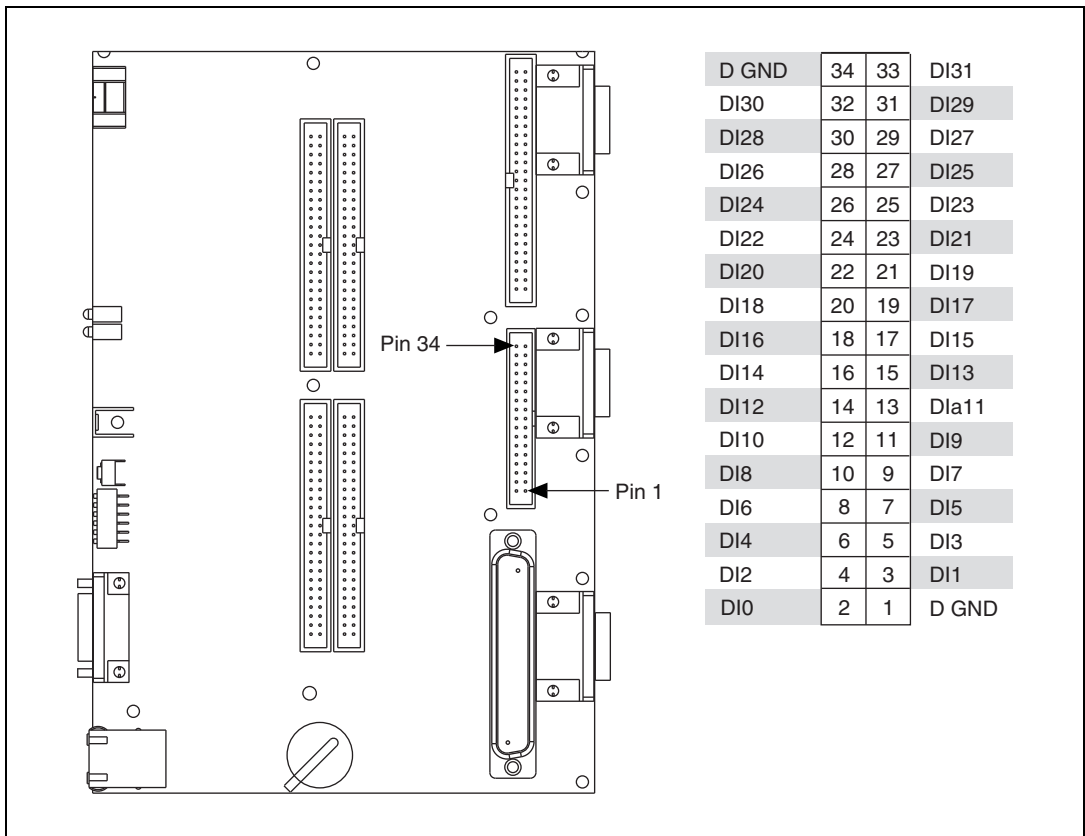


**Figure 10.** Pinout of I/O Connector J6, 24 V Digital Input (NI sbRIO-964x/9642XT Only)

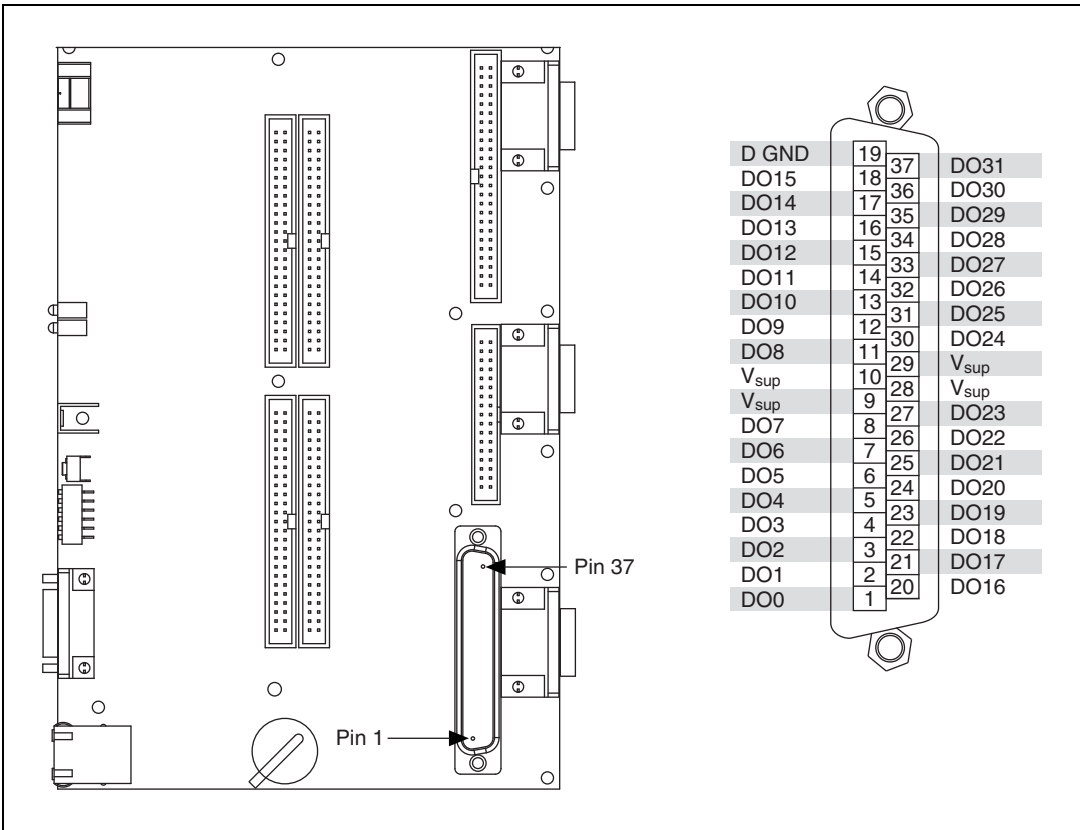

**Figure 11.** Pinout of I/O Connector J5, 24 V Digital Output (NI sbRIO-964x/9642XT Only)

Figure 12 shows the signals on J1, the RS-232 serial port.

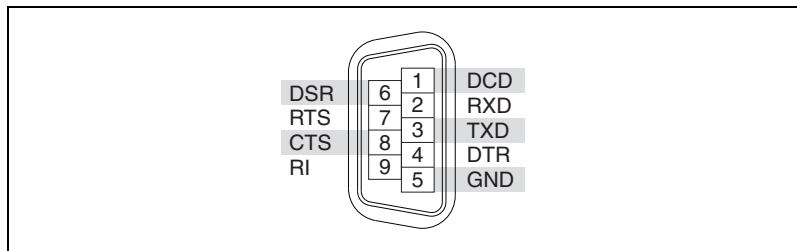

**Figure 12.** J1, RS-232 Serial Port



# Understanding Ground Connections

---

All of the grounds (D GND, AI GND, AO GND, ground lug P1, and the plated mounting holes) are connected together internally on the NI sbRIO device. The ESD protection diodes are connected to the plated mounting holes with a lower inductive path than the path to D GND, so the best ESD protection is provided by connecting the plated mounting holes and ground lug P1 to a low inductive earth ground.

Care must be taken to *not* connect the grounds in such a way that stray power supply currents traverse through the board. For example, when using the NI sbRIO-964x/9642XT, the D GND connections on the 24 V DIO connectors J5 and J6 should not be carrying more than a few tens of milliamps of current. Ideally, only the return current for the 24 V inputs should return through D GND on J5, and D GND on J6 should have no current flow. For the remaining connectors, a good rule of thumb is current flowing out of the connector should match current flowing in.

To verify correct grounding of the NI sbRIO device, make sure current flowing into the power connector J3 equals the current flowing out of power connector J3. These currents should be measured with a current probe after final assembly of the end product and any current differences investigated and removed.

All external power supplies should have their connected to a system ground external to the NI sbRIO device. Do not use the NI sbRIO device as the common system grounding point. Significant currents traversing through the NI sbRIO grounds can result in digital component failures. If more than 3 A flows through the common (–) pin on the J3 power connector, components start to fuse open.

## Connecting the NI sbRIO Device to a Network

---

Use a standard Category 5 (CAT-5) or better Ethernet cable to connect the RJ-45 Ethernet port to an Ethernet network.



**Caution** To prevent data loss and to maintain the integrity of your Ethernet installation, do *not* use a cable longer than 100 m.

If you need to build your own cable, refer to the [Cabling](#) section for more information about Ethernet cable wiring connections.

The host computer communicates with the device over a standard Ethernet connection. If the host computer is on a network, you must configure the device on the same subnet as the host computer. If neither the host computer nor the device is connected to a network, you can connect the two directly using a crossover cable.

If you want to use the device on a subnet other than the one the host computer is on, first connect the device on the same subnet as the host computer. Use DHCP to assign an IP address or reassign a static IP address for the subnet where you want it to be and physically move it to the other subnet. Refer to the *Measurement & Automation Explorer Help* for more information about configuring the device in Measurement & Automation Explorer (MAX).

## Powering the NI sbRIO Device

---


The NI sbRIO device requires a power supply connected to J3. The supply voltage and current must meet the specifications in the [Power Requirements](#) section of this document, but the actual power requirement depends on how the device is physically configured, programmed, and used. To determine the power requirement of your application, you must measure the power consumption during execution, and add 20% to your estimates to account for transient and startup conditions.



**Note** Select a high-quality power supply with less than 20 mV ripple. The NI sbRIO device has some internal power-supply filtering on the positive side, but a low-quality power supply can inject noise into the ground path, which is unfiltered.

Four elements of the NI sbRIO device can require power: NI sbRIO internal operation, including integrated analog and digital I/O; 3.3 V DIO; 5 V output; and board-only C Series modules installed on the device. Refer to the [Power Requirements](#) section for formulas and examples for calculating power requirements for different configurations and application types.

Complete the following steps to connect a power supply to the device. Refer to Figure 13 for an illustration of the power supply connection.

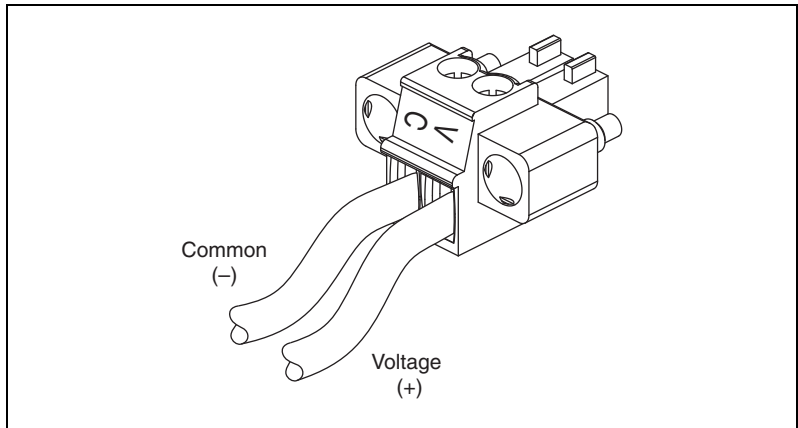

**Figure 13.** Connecting a Power Supply

1. Remove the MINI-COMBICON plug from connector J3 of the NI sbRIO device. Refer to Figure 4 for the location of J3.
2. Connect the positive lead of the power supply to the V terminal of the MINI-COMBICON plug.
3. Connect the negative lead of the power supply to the C terminal of the MINI-COMBICON plug.
4. Re-install the MINI-COMBICON connector in connector J3.



**Note** The 24 V digital output of the NI sbRIO-964x/9642XT requires a separate, additional power supply. Refer to the [Integrated 24 V Digital Output \(NI sbRIO-964x/9642XT Only\)](#) and [Specifications](#) sections for more information about powering digital output channels.

## Powering On the NI sbRIO Device

When you apply power to the NI sbRIO device, the device runs a power-on self test (POST). During the POST, the Power and Status LEDs turn on. When the Status LED turns off, the POST is complete. If the LEDs do not behave in this way when the system powers on, refer to the [Understanding LED Indications](#) section.

You can configure the device to launch an embedded stand-alone LabVIEW RT application each time it is booted. Refer to the [Running a Stand-Alone Real-Time Application \(RT Module\)](#) topic of the *LabVIEW Help* for more information.

## Boot Options

Table 2 lists the reset options available on NI sbRIO devices. These options determine how the FPGA behaves when the device is reset in various conditions. Use the RIO Device Setup utility to select reset options. Access the RIO Device Setup utility by selecting **Start»All Programs»National Instruments»NI-RIO»RIO Device Setup**.

**Table 2.** NI sbRIO Reset Options

Reset Option	Behavior
Do not autoload VI	Does not load the FPGA bit stream from flash memory.
Autoload VI on device powerup	Loads the FPGA bit stream from flash memory to the FPGA when the device powers on.
Autoload VI on device reboot	Loads the FPGA bit stream from flash to the FPGA when you reboot the device either with or without cycling power.



**Note** If you want a VI to run when loaded to the FPGA, complete the following steps.

1. Right-click the FPGA Target item in the **Project Explorer** window in LabVIEW.
2. Select **Properties**.
3. In the **General** category of the **FPGA Target Properties** dialog box, place a check in the **Run when loaded to FPGA** checkbox.
4. Compile the FPGA VI.

## Connecting Serial Devices to the NI sbRIO Device

---

The NI sbRIO device has an RS-232 serial port to which you can connect devices such as displays or input devices. Use the Serial VIs to read from and write to the serial port from a LabVIEW RT application. For more information about using the Serial VIs, refer to the *Serial VIs and Functions* topic of the *LabVIEW Help*.


## Using the Internal Real-Time Clock

---

The system clock of the NI sbRIO device gets the date and time from the internal real-time clock at startup. This synchronization provides timestamp data to the device.

# Configuring DIP Switches

---

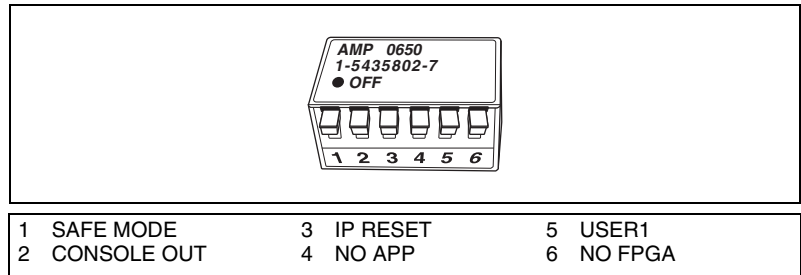

**Figure 14.** DIP Switches

All of the DIP switches are in the OFF (up) position when the NI sbRIO device is shipped from National Instruments.

## SAFE MODE Switch

The position of the SAFE MODE switch determines whether the embedded LabVIEW Real-Time engine launches at startup. If the switch is in the OFF position, the LabVIEW Real-Time engine launches. Keep this switch in the OFF position during normal operation. If the switch is in the ON position at startup, the NI sbRIO device launches only the essential services required for updating its configuration and installing software. The LabVIEW Real-Time engine does not launch.

Push the SAFE MODE switch to the ON position if the software on the NI sbRIO device is corrupted. Even if the switch is not in the ON position, if there is no software installed on the device, the device automatically boots into safe mode. The SAFE MODE switch must be in the ON position to reformat the drive on the device. Refer to the *Measurement & Automation Explorer Help* for more about installing software and reformatting the drive.

## CONSOLE OUT Switch

With a serial-port terminal program, you can use the serial port to read the IP address and firmware version of the NI sbRIO device. Use a null-modem cable to connect the serial port on the device to a computer. Push the CONSOLE OUT switch to the ON position. Make sure that the serial-port terminal program is configured to the following settings:

- 9,600 bits per second
- Eight data bits
- No parity
- One stop bit
- No flow control

Keep this switch in the OFF position during normal operation. If CONSOLE OUT is enabled, LabVIEW RT cannot communicate with the serial port.

## IP RESET Switch

Push the IP RESET switch to the ON position and reboot the NI sbRIO device to reset the IP address to 0 . 0 . 0 . 0. If the device is on your local subnet and the IP RESET switch is in the ON position, the device appears in MAX with IP address 0 . 0 . 0 . 0. You can configure a new IP address for the device in MAX. Refer to the [Resetting the Network Configuration of the NI sbRIO Device](#) section for more information about resetting the IP address.

## NO APP Switch

Push the NO APP switch to the ON position to prevent a LabVIEW RT startup application from running at startup. If you want to permanently disable a LabVIEW RT application from running at startup, you must disable it in LabVIEW. To run an application at startup, push the NO APP switch to the OFF position, create an application using the LabVIEW Application Builder, and configure the application in LabVIEW to launch at startup. For more information about automatically launching VIs at startup and disabling VIs from launching at startup, refer to the *Running a Stand-Alone Real-Time Application (RT Module)* topic of the *LabVIEW Help*.

## USER1 Switch

You can define the USER1 switch for your application. To define the purpose of this switch in your embedded application, use the RT Read Switch VI in your LabVIEW RT embedded VI. For more information about the RT Read Switch VI, refer to the *LabVIEW Help*.

## NO FPGA Switch

Push the NO FPGA switch to the ON position to prevent a LabVIEW FPGA application from loading at startup. The NO FPGA switch overrides the options described in the *Boot Options* section. After startup you can download bit files to flash memory from a LabVIEW project regardless of switch position. If you already have an application configured to launch at startup and you push the NO FPGA switch from ON to OFF, the startup application is automatically enabled.

## Using the Reset Button

Pressing the Reset button reboots the processor. The FPGA continues to run unless you select the **Autoload VI on device reboot** boot option. Refer to the *Boot Options* section for more information.

## Understanding LED Indications

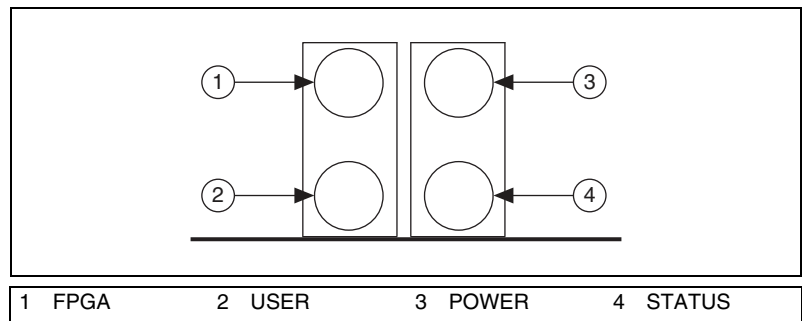


Figure 15. NI sbRIO Device LEDs

### FPGA LED

You can use the FPGA LED to help debug your application or easily retrieve application status. Use the LabVIEW FPGA Module and NI-RIO software to define the FPGA LED to meet the needs of your application. Refer to *LabVIEW Help* for information about programming this LED.

### USER LED

You can define the USER LED to meet the needs of your application. To define the LED, use the RT LEDs VI in LabVIEW. For more information about the RT LEDs VI, refer to the *LabVIEW Help*.

## POWER LED

The POWER LED is lit while the NI sbRIO device is powered on. This LED indicates that the 5 V and 3.3 V rails are stable.

## STATUS LED

The STATUS LED is off during normal operation. The NI sbRIO device indicates specific error conditions by flashing the STATUS LED a certain number of times as shown in Table 3.

**Table 3.** Status LED Indications

<b>Number of Flashes</b>	<b>Indication</b>
1 (one flash every couple seconds)	The device is unconfigured. Use MAX to configure the device. Refer to the <i>Measurement &amp; Automation Explorer Help</i> for information about configuring the device.
2	The device has detected an error in its software. This usually occurs when an attempt to upgrade the software is interrupted. Reinstall software on the device. Refer to the <i>Measurement &amp; Automation Explorer Help</i> for information about installing software on the device.
3	The device is in safe mode because the SAFE MODE DIP switch is in the ON position. Refer to the <a href="#">Configuring DIP Switches</a> section for information about the SAFE MODE DIP switch.
4	The device software has crashed twice without rebooting or cycling power between crashes. This usually occurs when the device runs out of memory. Review your RT VI and check the device memory usage. Modify the VI as necessary to solve the memory usage issue.
Continuous flashing or solid	The device has detected an unrecoverable error. Format the hard drive on the device. If the problem persists, contact National Instruments.



# Resetting the Network Configuration of the NI sbRIO Device

---

If the NI sbRIO device is not able to communicate with the network, you can use the IP RESET switch to manually restore the device to the factory network settings. When you restore the device to the factory network settings, the IP address, subnet mask, DNS address, gateway, and Time Server IP are set to 0.0.0.0. Power-on defaults, watchdog settings, and VIs are unaffected.

Complete the following steps to restore the device to the factory network settings.

1. Move the IP RESET DIP switch to the ON position.
2. Press the Reset button.
3. Move the IP RESET switch to the OFF position.

The network settings are restored. You can reconfigure the settings in MAX from a computer on the same subnet. Refer to the *Measurement & Automation Explorer Help* for more information about configuring the device.



**Note** If the device is restored to the factory network settings, the LabVIEW run-time engine does not load. You must reconfigure the network settings and reboot the device for the LabVIEW run-time engine to load.

# Integrated 3.3 V Digital I/O

The four 50-pin IDC headers, P2–P5, provide connections for 110 low-voltage DIO channels, 82 D GND, and eight +5 V voltage outputs. Figure 16 represents a single DIO channel.

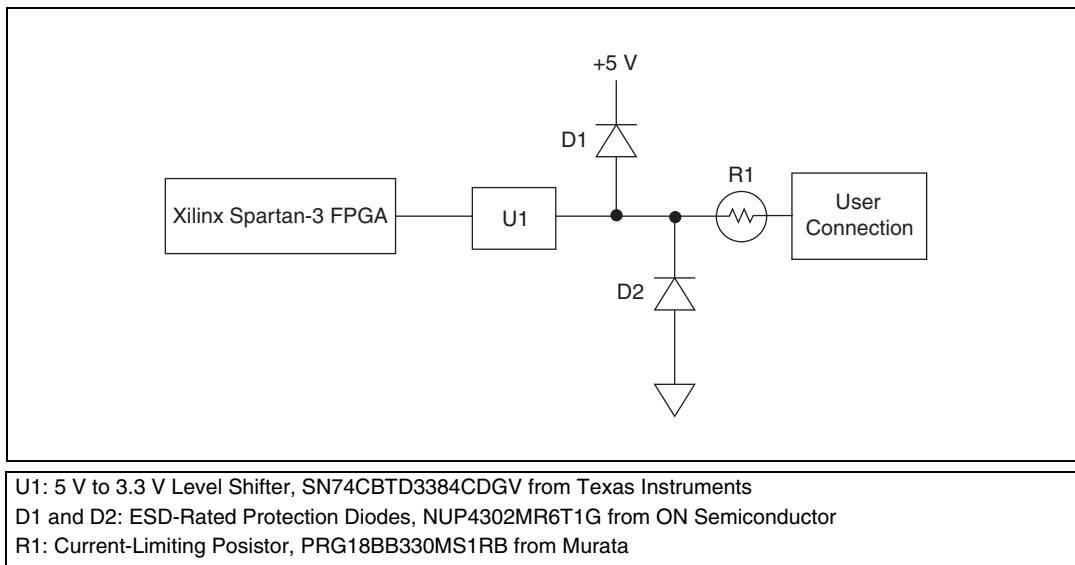


Figure 16. Circuitry of One 3.3 V DIO Channel

## I/O Protection

The 33  $\Omega$  current-limiting posistor, R1, and the protection diodes, D1 and D2, protect each DIO channel against externally applied voltages and ESD events. The combination of R1 and D1 protects against overvoltage, and the combination of R1 and D2 protects against undervoltage. The resistance of R1 increases rapidly with temperature. During overvoltage conditions, high current flows through R1 and into the protection diodes. High current causes internal heating in the posistor, which increases the resistance and limits the current. Refer to the [Specifications](#) section for current-limiting and resistance values.

## Drive Strength

The NI sbRIO devices are tested with all 110 DIO channels driving 3 mA DC loads, for a total of 330 mA sourcing from the FPGA. The FPGA uses minimum 8 mA drivers, but the devices are not characterized for loads higher than 3 mA.

## Signal Integrity

NI sbRIO boards have a 60  $\Omega$  characteristic trace impedance. The characteristic impedance of most IDC ribbon cables is 110  $\Omega$ , which is grossly mismatched from the board. However, headers P2–P5 were designed such that the signals are interwoven with ground (signal/ground/signal/ground, etc.), which greatly improves the signal integrity. This is sufficient for most applications

For the best possible signal integrity, use a 3M 3353 series ribbon cable, which has a characteristic impedance of 65  $\Omega$ . This cable has a ground plane that connects to the ground plane of the board at pin 1 and pin 50. The internal ground plane of this cable also reduces noise and radiated emissions.

## Using +5 V Power from 3.3 V DIO Headers P2–P5


Each of the four DIO headers has two pins to provide +5 V power for external applications. These +5 V outputs are referenced to D GND on the headers and are connected directly to the internal 5 V power plane of the NI sbRIO device. The +5 V source has current limiting and overvoltage clamps. Nevertheless, sudden current steps and noisy loads can inject high-frequency transients into the power planes of the device. Such transients can cause intermittent failures in the digital timing and lead to unexpected behavior. Add filters and/or additional current limiting between the external load and the +5 V output if the external load is not a quiet, slowly ramping DC load. An LC filter of 6.8  $\mu\text{H}$  and 100  $\mu\text{F}$  per 200 mA load should be sufficient, but the OEM user is responsible for final requirements and testing.

The NI sbRIO power supply has a total of 2 A external load at 5 V. This total includes 200 mA per installed C Series module. For example, if three C Series modules are installed, only 2 A – (3  $\times$  0.2) = 1.4 A is available for use on headers P2–P5. Each pin on the headers is rated for 2 A, but a typical 28 AWG ribbon cable is rated for only 225 mA per conductor. The OEM user is responsible for determining cabling requirements and ensuring that current limits are not exceeded.

# Integrated Analog Input

Connector J7 provides connections for 32 single-ended analog input channels or 16 differential analog input channels. Connector J7 also provides one connection for AI SENSE and nine connections for AI GND. Refer to the *I/O and Other Connectors on the NI sbRIO Device* section for a pinout of connector J7.

The integrated analog input of the NI sbRIO device is similar to that of the NI 9205, but there is no isolation or digital I/O. Figure 17 shows the input circuitry for one channel.

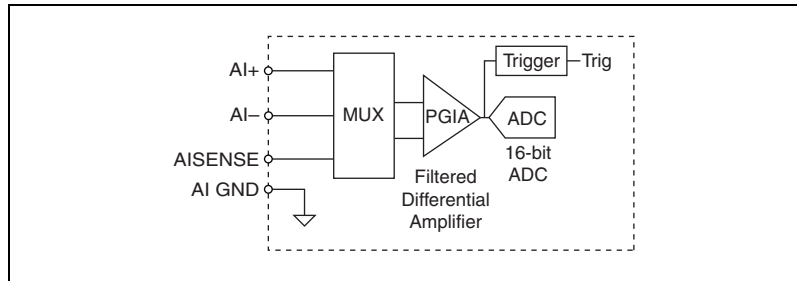

**Figure 17.** Input Circuitry for One Analog Channel

The remainder of this section provides a brief discussion of possible analog input configurations. For a more in-depth discussion and examples, refer to the *Analog Input* chapter of the *M Series User Manual* on [ni.com](http://ni.com).


## Differential Measurement Configurations

You can use a differential measurement configuration to attain more accurate measurements and less noise. A differential measurement configuration requires two inputs for each measurement, thus reducing the number of available channels to 16. Table 4 shows the signal pairs that are valid for differential connection configurations.

**Table 4.** Differential Pairs

Channel	Signal+	Signal-	Channel	Signal+	Signal-
0	AI0	AI8	16	AI16	AI24
1	AI1	AI9	17	AI17	AI25
2	AI2	AI10	18	AI18	AI26
3	AI3	AI11	19	AI19	AI27
4	AI4	AI12	20	AI20	AI28
5	AI5	AI13	21	AI21	AI29
6	AI6	AI14	22	AI22	AI30
7	AI7	AI15	23	AI23	AI31


Figure 18 shows how to make a differential connection for a floating signal and for a ground-referenced signal.

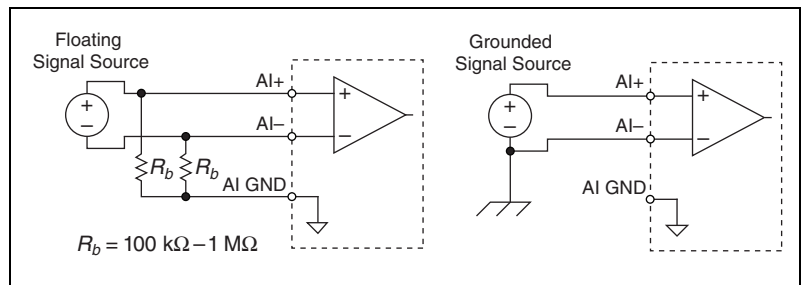

**Figure 18.** Differential Analog Input Connection

## Referenced Single-Ended (RSE) Measurements

You can use an RSE measurement configuration to take measurements on 32 channels when all channels share a common ground. Figure 19 shows how to make an RSE analog input connection for a floating signal. National Instruments does *not* recommend making an RSE connection for a ground-referenced signal.

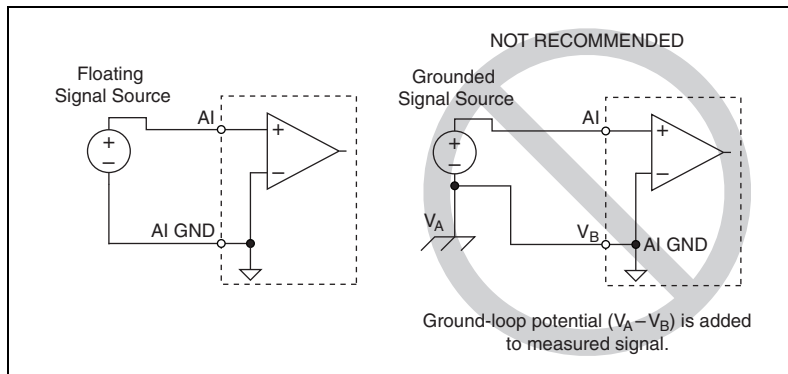


**Figure 19.** RSE Analog Input Connection

In an RSE connection configuration, the NI sbRIO device measures each input channel with respect to AI GND.

## Non-Referenced, Single-Ended (NRSE) Measurements

You can use an NRSE measurement configuration to take measurements on all 32 channels while reducing noise more effectively than with an RSE connection configuration. This configuration provides remote sense for the negative (-) input of the programmable gain instrumentation amplifier (PGIA) that is shared by all channels configured for NRSE mode. The behavior of this configuration is similar to the behavior of RSE connections, but it provides improved noise rejection. Figure 20 shows how to make an NRSE analog input connection for a floating signal and for a ground-referenced signal.

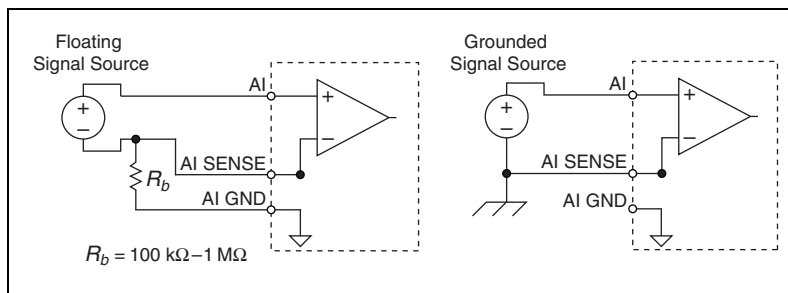

**Figure 20.** NRSE Analog Input Connection




**Note** The analog input and analog output of the NI sbRIO-963x/9632XT/964x/9642XT share an internal power supply. Putting the analog input into Sleep Mode turns off analog output as well. However, putting analog output into Sleep Mode does not turn off analog input.

## Integrated Analog Output (NI sbRIO-963x/9632XT/964x/9642XT Only)

Connector J7 of the NI sbRIO-963x/9632XT/964x/9642XT provides connections for four analog output channels. Refer to the [I/O and Other Connectors on the NI sbRIO Device](#) section for a pinout of connector J7.

The integrated analog output of the NI sbRIO device is similar to that of the NI 9263, but there is no isolation. Each channel has a digital-to-analog converter that produces a voltage signal. Each channel also has overvoltage and short-circuit protection. Refer to the [Specifications](#) section for information about the overvoltage and short-circuit protection.


Figure 21 shows the analog output circuitry for one channel.

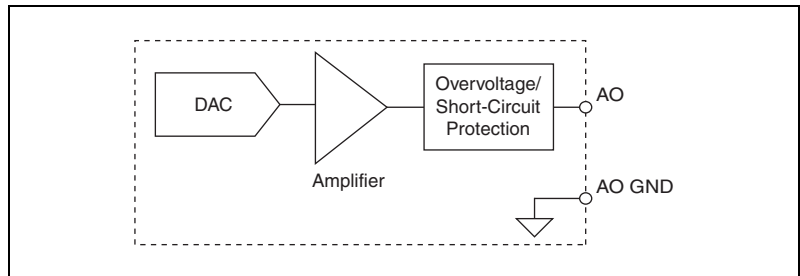

**Figure 21.** Analog Output Circuitry for One Channel

When you apply power to the NI sbRIO device, analog output channels are unpowered until data is written to them. When the channels receive the first data, they turn on and drive the output voltage configured in software. This behavior is similar to that of the NI 9263. Refer to the [Specifications](#) section for more information about power-on voltage. Refer to the software help for information about configuring startup output states in software.

Connect the positive lead of the load to the AO terminal. Connect the ground of the load to an AO GND terminal. Figure 22 shows a load connected to one analog input channel.

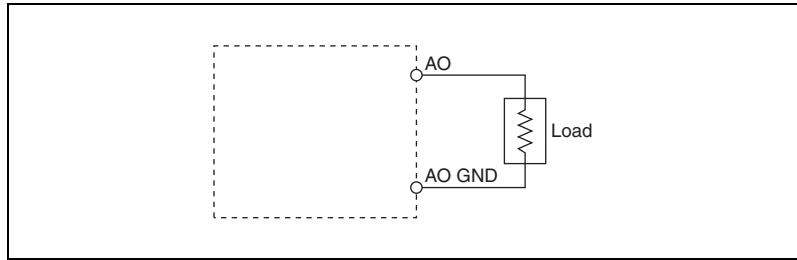

**Figure 22.** Load Connected to One Analog Input Channel

## Integrated 24 V Digital Input (NI sbRIO-964x/9642XT Only)

---


Connector J6 of the NI sbRIO-964x/9642XT provides connections for 32 simultaneously sampled digital input channels. Each channel has one pin, DI, to which you can connect a digital input signal. The remaining two pins of J6 are the ground reference pins, D GND. Refer to the [I/O and Other Connectors on the NI sbRIO Device](#) section for a pinout of connector J6.

The integrated digital input of the NI sbRIO device is similar to that of the NI 9425, but there is no isolation. The 24 V digital input channels are sinking inputs, meaning that when the device drives a current or applies a voltage to the DI pin, the pin provides a path to D GND. D GND is the current return path for sourcing digital input devices. The NI sbRIO-964x/9642XT internally limits current signals connected to DI. For more information about input current protection, refer to the [Specifications](#) section.

You can connect 2-, 3-, and 4-wire sourcing-output devices to the NI sbRIO-964x/9642XT. A sourcing-output device drives current or applies voltage to the DI pin. An example of a sourcing-output device is an open collector PNP.



Connect the sourcing-output device to the DI pin on the NI sbRIO-9642/9642XT. Connect the common of the external device to the D GND pin. Refer to Figure 23 for an illustration of connecting a device to the NI sbRIO-9642/9642XT.

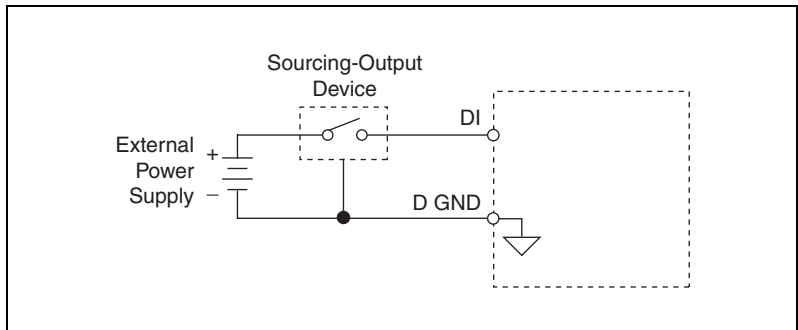

**Figure 23.** Device Connected to One Digital Input Channel

The digital input channel registers as ON when the sourcing-output device applies a voltage or drives a current to the DI pin that is in the input ON range. The channel registers as OFF when the device applies a voltage or drives a current to the DI pin that is in the input OFF range. If no device is connected to the DI pin, the channel registers as OFF. Refer to the [Specifications](#) section for more information about ON and OFF states.


## Integrated 24 V Digital Output (NI sbRIO-964x/9642XT Only)

Connector J5 of the NI sbRIO-964x/9642XT provides connections for 32 current-sourcing digital output channels. Refer to the [I/O and Other Connectors on the NI sbRIO Device](#) section for a pinout of connector J5.

The DO pin of the channel drives current or applies voltage to a connected device. You can directly connect the NI sbRIO-964x/9642XT to a variety of industrial devices such as motors, actuators, relays, and lamps. Make sure the devices you connect to the NI sbRIO-964x/9642XT are compatible with the output specifications. Refer to the [Specifications](#) section for the output specifications.

The 24 V digital outputs of the NI sbRIO-964x/9642XT require a 6–35 VDC power supply separate from the power supply connected to J3.


Connect the device to DO and D GND, and connect the external power supply to  $V_{sup}$  and D GND, as shown in Figure 24.

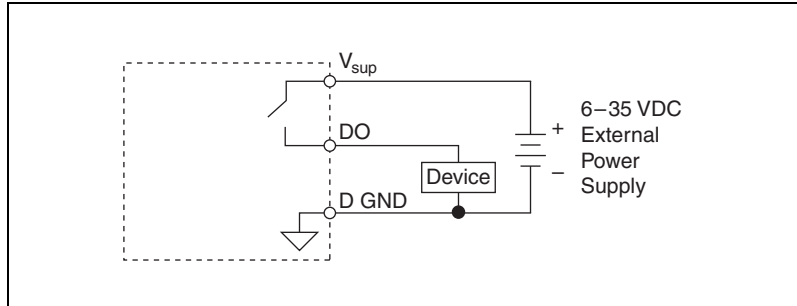

**Figure 24.** Device Connected to One Digital Output Channel

## Increasing Current Drive

If you do not modify the NI sbRIO device, each channel has a continuous output current of 250 mA. If you want to increase the output current to a device, you can connect any number of channels together in parallel. For example, if you want to drive 1 A of current, connect DO<0..3> in parallel as shown in Figure 25. You must turn all parallel channels on and off simultaneously so that the current on any single channel cannot exceed the 250 mA rating. You must also select heavier cabling for the connection between the negative terminal of the device and the negative terminal of the power supply for the device. Refer to Figure 25 and use heavier cabling where indicated by heavier traces.

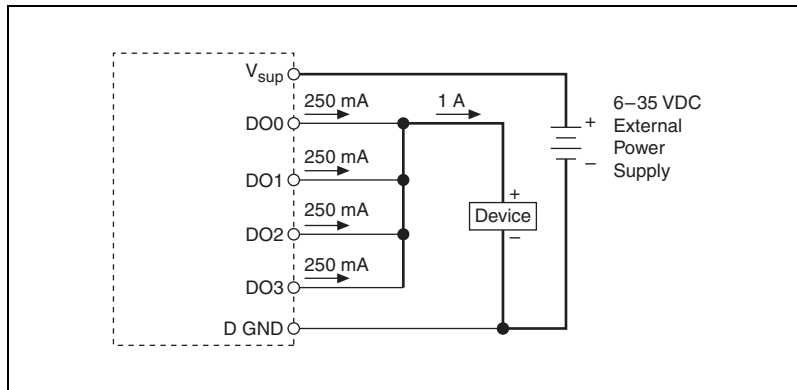

**Figure 25.** Increasing the Current to a Device



**Note** Refer to the [Understanding Ground Connections](#) section for cautions about D GND.

If you add heat sinks to the output transistors U49–U56 and U110–U117, such that the measured case temperature of the transistors remains below 65 °C at ambient temperature of 55 °C, each channel can drive up to 1.5 A. However, the total current through all channels must not exceed 20 A.<sup>1</sup> Use a heat sink that dissipates 0.5 W for each transistor driving up to 1.5 A. For example, for four transistors, each driving 1.5 A, use a 2 W heat sink. Table 5 shows the channels associated with the output transistors.

**Table 5.** Transistors Associated with DO Channels


<b>DO Channels</b>	<b>Transistor</b>
0, 1	U49
2, 3	U50
4, 5	U51
6, 7	U52
8, 9	U53
10, 11	U54
12, 13	U55
14, 15	U56
16, 17	U117
18, 19	U116
20, 21	U115
22, 23	U114
24, 25	U113
26, 27	U112
28, 29	U111
30, 31	U110

---

<sup>1</sup> The 20 A total-current limit is based on the maximum current rating of the DSUB connector pins, 5 A, multiplied by 4, the number of  $V_{\text{sup}}$  pins.

## Protecting the NI sbRIO Device from Flyback Voltages

If a digital output channel is switching an inductive or energy-storing device such as a motor, solenoid, or relay, and the device does not have flyback protection, install a flyback diode as shown in Figure 26.

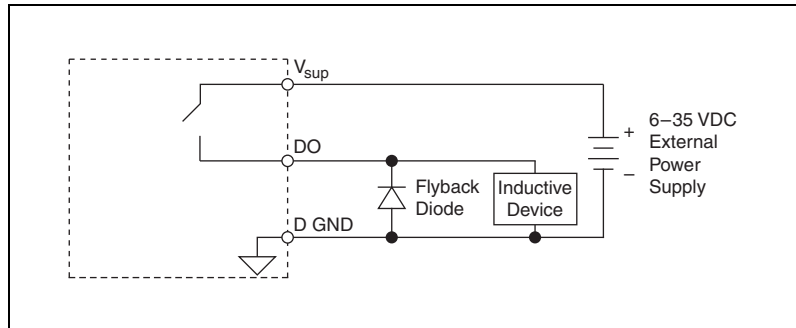

**Figure 26.** Connecting a Flyback Diode to the NI sbRIO 964x/9642XT

## I/O Protection

The NI sbRIO-964x/9642XT is protected against overcurrent, inrush, and short-circuit conditions in accordance with IEC 1131-2.

Each digital output channel on the NI sbRIO-964x/9642XT has circuitry that protects it from voltage and current surges resulting from short circuits.



**Caution** The NI sbRIO-964x/9642XT can be damaged under overvoltage and reverse bias voltage conditions. Check the voltage specifications for all devices that you connect to the NI sbRIO-964x/9642XT.

Excessive current through a DO pin causes the channel to go into an overcurrent state. In an overcurrent state, the channel cycles off and on until the short circuit is removed or the current returns to an acceptably low level. Refer the [Specifications](#) section for typical trip currents.

Each channel has a status line that indicates in software whether the channel is in an overcurrent state. Refer to the software help for information about the status line.

# Specifications

---

Unless otherwise noted, the following specifications are typical for the range -40 to 85 °C for the NI sbRIO-96x2XT, and for the range -20 to 55 °C for the NI sbRIO-961x/963x/964x.

## Network

Network interface .....	10BaseT and 100BaseTX Ethernet
Compatibility .....	IEEE 802.3
Communication rates .....	10 Mbps, 100 Mbps, auto-negotiated
Maximum cabling distance .....	100 m/segment

## RS-232 DTE Serial Port

Baud rate support .....	Arbitrary
Maximum baud rate .....	115,200 bps
Data bits .....	5, 6, 7, 8
Stop bits.....	1, 2
Parity .....	Odd, Even, Mark, Space, None
Flow control .....	RTS/CTS, XON/XOFF, DTR/DSR, None

## Processor Speed

NI sbRIO-9611/9631/9641 .....	266 MHz
NI sbRIO-9612/9632/9642 and NI sbRIO-96x2XT.....	400 MHz

# Memory

## Nonvolatile memory

NI sbRIO-9611/9631/9641 .....	128 MB minimum
NI sbRIO-9612/9632/9642 and NI sbRIO-96x2XT .....	256 MB minimum

## System memory

NI sbRIO-9611/9631/9641 .....	64 MB minimum
NI sbRIO-9612/9632/9642 and NI sbRIO-96x2XT .....	128 MB minimum

For information about the life span of the nonvolatile memory and about best practices for using nonvolatile memory, go to [ni.com/info](http://ni.com/info) and enter the Info Code `SSDBP`.

# Xilinx Spartan-3 Reconfigurable FPGA

## Number of logic cells

NI sbRIO-9611/9631/9641 .....	17,280
NI sbRIO-9612/9632/9642 and NI sbRIO-96x2XT .....	46,080

## Available embedded RAM

NI sbRIO-9611/9631/9641 .....	432 kbits
NI sbRIO-9612/9632/9642 and NI sbRIO-96x2XT .....	720 kbits

# 3.3 V Digital I/O

Number of DIO channels..... 110

Maximum tested current per channel ..... 3 mA

Maximum total current, all lines..... 330 mA

Maximum tested DIO frequency ..... 10 MHz

## Input logic levels

Input high voltage, $V_{IH}$ .....	2.0 V min; 5.25 V max
Input low voltage, $V_{IL}$ .....	0 V min; 0.8 V max

### Output logic levels

Output high voltage, $V_{OH}$ , sourcing 3 mA.....	2.7 V min; 3.3 V max
Output low voltage, $V_{OL}$ , sinking 3 mA.....	0.07 V min; 0.54 V max


### Overvoltage protection (maximum 2 pins in overvoltage)

NI sbRIO-961x/963x/964x at -20 to 55 °C .....	±20 V
NI sbRIO-96x2XT at -20 to 85 °C .....	±20 V
at -40 to -20 °C .....	±7 V

### Posistor (PRG18BB330MS1RB from Murata)

Maximum peak abnormal-condition current.....	760 mA
Maximum hold current at 25 °C .....	36 mA
Maximum hold current at 70 °C .....	20 mA
Maximum hold current at 85 °C (NI sbRIO-96x2XT only).....	3 mA
Trip current at 25 °C .....	71 mA
Resistance at 25 °C .....	33 Ω ±20%

# Resistance-temperature characteristics, typical curve

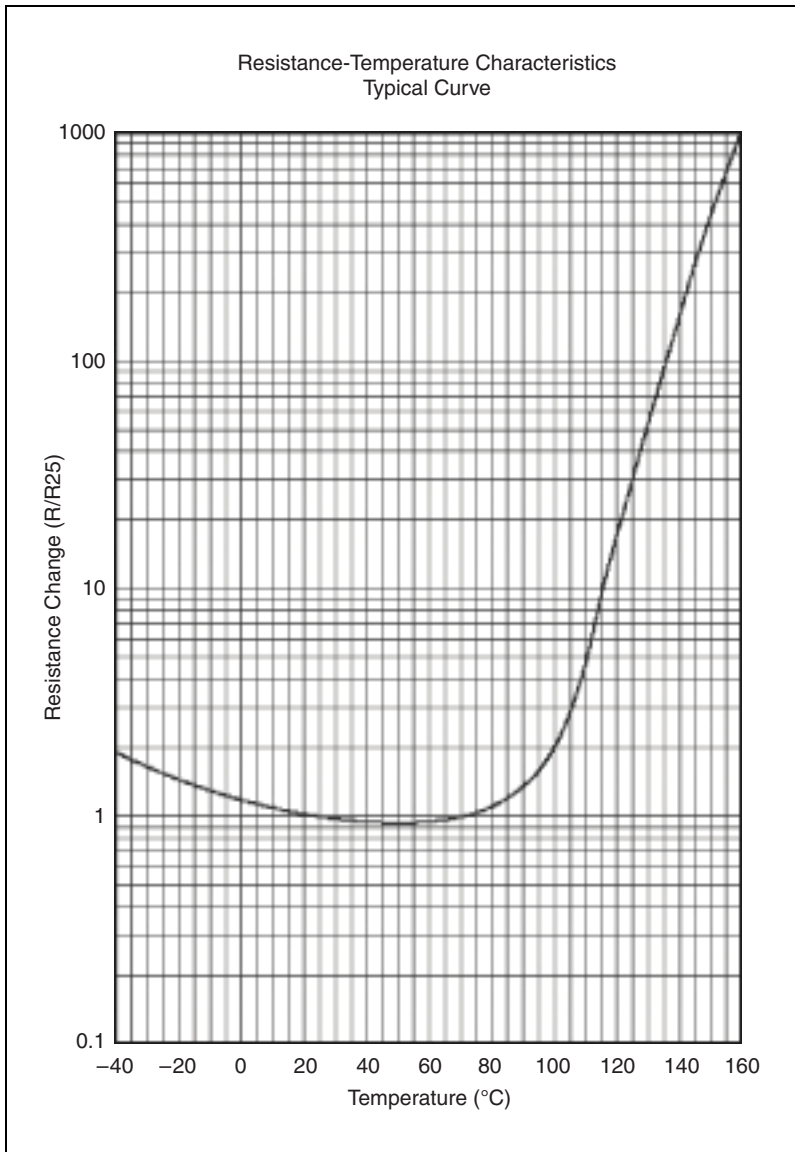






# Analog Input

All voltages are relative to AI GND unless otherwise noted.

Number of channels .....	32 single-ended or 16 differential analog input channels
ADC resolution .....	16 bits
Differential nonlinearity.....	No missing codes guaranteed
Integrated nonlinearity .....	Refer to the <i>AI Absolute Accuracy Tables and Formulas</i>
Conversion time .....	4.00 $\mu$ s (250 kS/s)
Input coupling .....	DC
Nominal input ranges .....	$\pm 10$ V, $\pm 5$ V, $\pm 1$ V, $\pm 0.2$ V
Minimum overrange (for 10 V range).....	4%
Maximum working voltage for analog inputs (signal + common mode) .....	Each channel must remain within $\pm 10.4$ V of common
Input impedance (AI-to-AI GND)	
Powered on .....	$>10$ G $\Omega$ in parallel with 100 pF
Powered off/overload.....	1.2 k $\Omega$ min
Input bias current .....	$\pm 100$ pA
Crosstalk (at 100 kHz)	
Adjacent channels .....	-65 dB
Non-adjacent channels .....	-70 dB
Small-signal bandwidth.....	700 kHz
Overvoltage protection	
AI channel (0 to 31).....	$\pm 24$ V (one channel only)
AISENSE .....	$\pm 24$ V
CMRR (DC to 60 Hz) .....	92 dB

## Typical performance graphs

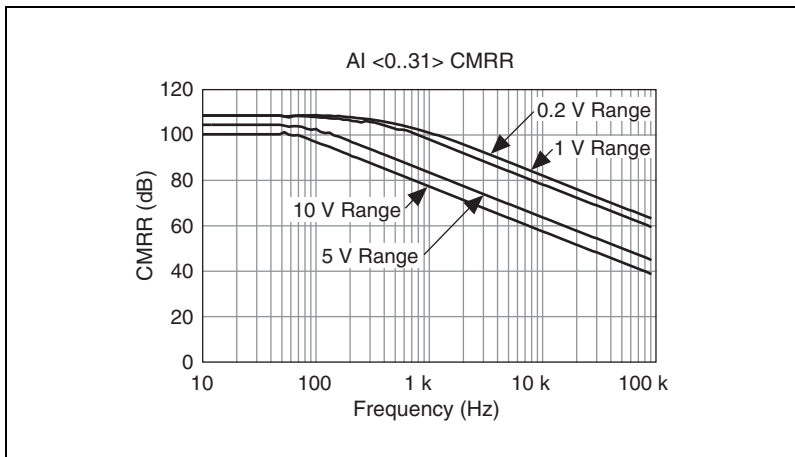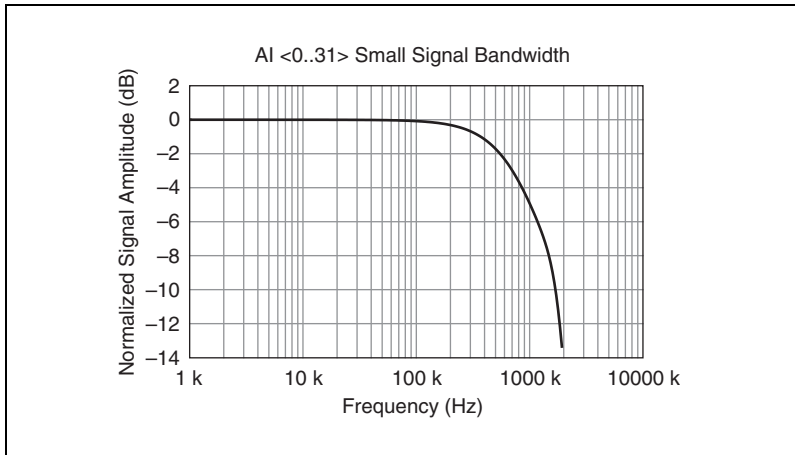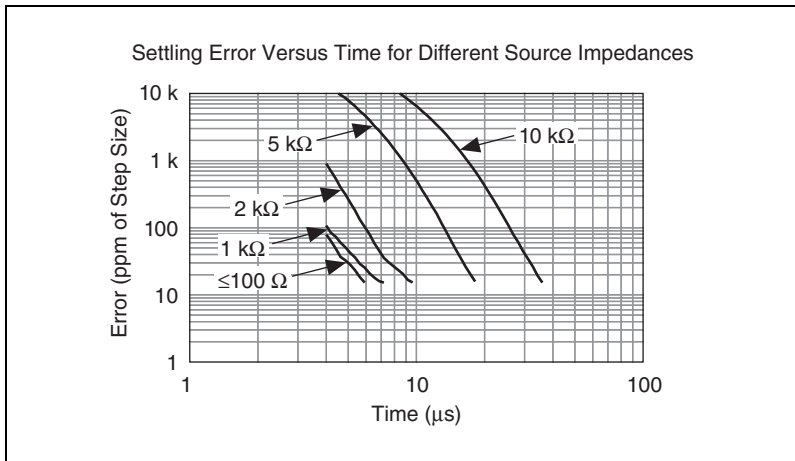



## Accuracy details

Nominal Range (V)	Residual Gain Error (ppm of Reading)	Gain Tempco (ppm/°C)	Reference Tempco	Residual Offset Error (ppm of Range)	Offset Tempco (ppm of Range/°C)	INL Error (ppm of Range)
±10	94	23	5	20	49	76
±5	104	23	5	20	50	76
±1	114	23	5	25	62	76
±0.2	154	23	5	40	118	76

### Absolute accuracy formulas

$$\text{AbsoluteAccuracy} = \text{Reading} \cdot \text{GainError} + \text{Range} \cdot \text{OffsetError} + \text{NoiseUncertainty}$$

$$\text{GainError} = \text{ResidualGainError} + \text{GainTempco} \cdot \text{TempChangeFromLastInternalCal} + \text{ReferenceTempco} \cdot \text{TempChangeFromLastExternalCal}$$

$$\text{OffsetError} = \text{ResidualOffsetError} + \text{OffsetTempco} \cdot \text{TempChangeFromLastInternalCal} + \text{INL\_Error}$$

$$\text{NoiseUncertainty} = (\text{RandomNoise} \cdot 3) / \sqrt{100} \text{ for a coverage factor of } 3\sigma \text{ and averaging 100 points.}$$

Absolute accuracy at full scale on the analog input channels is determined using the following assumptions:

$$\text{TempChangeFromLastExternalCal} = 45 \text{ }^\circ\text{C}$$

$$\text{TempChangeFromLastInternalCal} = 5 \text{ }^\circ\text{C}$$

$$\text{NumberOfReadings} = 100$$

$$\text{CoverageFactor} = 3 \sigma$$

For example, on the 10 V range, the absolute accuracy at full scale is as follows:

$$\begin{aligned} \text{GainError} &= 94 \text{ ppm} + 23 \text{ ppm} \cdot 5 + 5 \text{ ppm} \cdot 45 \\ \text{GainError} &= 434 \text{ ppm} \end{aligned}$$

$$\begin{aligned} \text{OffsetError} &= 20 \text{ ppm} + 49 \text{ ppm} \cdot 5 + 76 \text{ ppm} \\ \text{OffsetError} &= 341 \text{ ppm} \end{aligned}$$

$$\text{NoiseUncertainty} = (244 \mu\text{V} \cdot 3) / \sqrt{100}$$

$$\text{Noise Uncertainty} = 73.2 \mu\text{V}$$

$$\text{AbsoluteAccuracy} = 10 \text{ V} \cdot 434 \text{ ppm} + 10 \text{ V} \cdot 341 \text{ ppm} + 73.2 \mu\text{V}$$

$$\text{AbsoluteAccuracy} = 7,823 \mu\text{V} \text{ (rounds to } 7,820 \mu\text{V)}$$

To determine the absolute accuracy over the full operating temperature range, let:

$$\text{TempChangeFromLastInternalCal} = 45 \text{ }^\circ\text{C}$$

## Analog Output (NI sbRIO-963x/9632XT and NI sbRIO-964x/9642XT Only)

Number of channels ..... 4 analog output channels

DAC resolution ..... 16 bits

Type of DAC..... String

Output range.....  $\pm 10 \text{ V}$

Operating voltage

Nominal .....  $\pm 10.7 \text{ V}$

Minimum .....  $\pm 10.3 \text{ V}$

Maximum.....  $\pm 11 \text{ V}$

Current drive .....  $\pm 3 \text{ mA}$  per channel

Output impedance .....  $0.1 \Omega$

Accuracy

Measurement Conditions	Percent of Reading (Gain Error)	Percent of Range* (Offset Error)
Calibrated, max ( $-40$ to $85 \text{ }^\circ\text{C}$ )	0.35%	0.75%
Calibrated, typ ( $25 \text{ }^\circ\text{C}$ , $\pm 5 \text{ }^\circ\text{C}$ )	0.01%	0.1%
Uncalibrated, max ( $-40$ to $85 \text{ }^\circ\text{C}$ )	2.2%	1.7%
Uncalibrated, typ ( $25 \text{ }^\circ\text{C}$ , $\pm 5 \text{ }^\circ\text{C}$ )	0.3%	0.25%
* Range equals $\pm 10.7 \text{ V}$		

Stability

Offset drift.....  $80 \mu\text{V}/^\circ\text{C}$

Gain drift.....  $6 \text{ ppm}/^\circ\text{C}$

Protection

Overvoltage .....±25 V at 25 °C  
Short-circuit.....Indefinitely

Power-on voltage .....0 V



**Note** All analog outputs are unpowered until a value is written to an analog output.

Update time

One channel in use.....3 μs  
Two channels in use .....5 μs  
Three channels in use .....7.5 μs  
Four channels in use .....9.5 μs

Noise

Updating at 100 kS/s .....600 μV<sub>rms</sub>  
Not updating .....260 μV<sub>rms</sub>

Slew rate .....4 V/μs

Crosstalk .....76 dB

Settling time (100 pF load, to 1 LSB)

FS step .....20 μs  
3 V step.....10 μs  
0.1 V step.....8 μs

Glitch energy

(256 steps, worst case).....2 mV for 2 μs

Capacitive drive .....1,500 pF min

Monotonicity .....16 bits

Differential nonlinearity .....-1 to 2 LSBs max

Integrated nonlinearity (endpoint) .....16 LSBs max

## 24 V Digital Input (NI sbRIO-964x/9642XT Only)

Number of channels .....	32 digital input channels
Input type .....	Sinking
Digital logic levels	
OFF state	
Input voltage .....	$\leq 5\text{ V}$
Input current .....	$\leq 150\ \mu\text{A}$
ON state	
Input voltage .....	$\geq 10\text{ V}$
Input current .....	$\geq 330\ \mu\text{A}$
Hysteresis	
Input voltage .....	2 V min
Input current .....	60 $\mu\text{A}$ min
Input impedance .....	30 k $\Omega$ $\pm 5\%$
Input protection	
8 channels .....	60 VDC max
32 channels .....	30 VDC max
Setup time <sup>1</sup> .....	1 $\mu\text{s}$ max
Transfer time <sup>2</sup> .....	7 $\mu\text{s}$ max

## 24 V Digital Output (NI sbRIO-964x/9642XT Only)

Number of channels .....	32 digital output channels	
Output type .....	Sourcing	
Output voltage ( $V_O$ ) .....	$V_{\text{sup}} - (I_O R_O)$	
Input voltage from external power supply .....		6–35 VDC
Continuous output current ( $I_O$ ) on each channel		
No heat sinks .....	250 mA max	
With external heat sinks added <sup>3</sup> .....	1.5 A max	

<sup>1</sup> *Setup time* is the amount of time input signals must be stable before you can read from the module.

<sup>2</sup> *Transfer time* is the maximum time FPGA Device I/O functions take to read data from the module.

<sup>3</sup> Refer to the [Increasing Current Drive](#) section for information about installing heat sinks.

Maximum total output current on all channels .....	20 A
Output impedance ( $R_{\theta}$ ) .....	0.3 $\Omega$ max
Continuous overvoltage protection range ( $V_{sup}$ ) .....	40 V
Reversed-voltage protection .....	None
Current limiting .....	None
Short-circuit protection .....	Indefinitely protected when a channel is shorted to D GND or to a voltage up to $V_{sup}$
Trip current for one channel	
With all other channels at 250 mA current .....	3 A typ
With all other channels off .....	5 A typ
$V_{sup}$ quiescent current consumption .....	28 mA max
Maximum update rate .....	40 $\mu$ s max
Propagation delay .....	500 $\mu$ s max

## Power Limits



**Caution** Exceeding the power limits may cause unpredictable behavior by the device.

5 V pins (P2, P3, P4, P5) .....	+5 V $\pm$ 5%, 2 A max (shared with C Series modules)
---------------------------------	---

## Power Requirements

The NI sbRIO device requires a power supply connected to connector J3. Refer to Figure 4 for the location of J3. Refer to the [Powering the NI sbRIO Device](#) section for information about connecting the power supply.

Power supply voltage range .....	19–30 VDC <sup>1</sup>
Power supply current limit .....	1.8 A

<sup>1</sup> The NI sbRIO device is 1–2% more efficient with a 19 V supply than with a 30 V supply.



Power connector internal fuse..... 2 A non-replaceable

$$\text{Total power requirement} = P_{int} + P_{DIO} + P_{5V} + P_{CSer}$$

where  $P_{int}$  is the consumption by sbRIO internal operation, including integrated I/O

$P_{DIO}$  is the consumption by the 3.3 V DIO

$P_{5V}$  is the consumption by the 5 V voltage output

$P_{CSer}$  is the consumption by installed board-only C Series modules



**Note** You must add 20% to the calculated or measured total power requirement to account for transient and startup conditions.

Maximum  $P_{int}$

NI sbRIO-961x/9612XT ..... 7.50 W

NI sbRIO-963x/9632XT ..... 7.75 W

NI sbRIO-964x/9642XT ..... 8.00 W

Maximum  $P_{DIO}$ ..... 1.28 W

$$P_{DIO} = \text{Total DIO Current} \times 3.3 \text{ V}/0.85$$

Maximum  $P_{5V}$  ..... 11.1 W

$$P_{5V} = \text{Total 5 V Output Current} \times 5 \text{ V}/0.9$$

Maximum  $P_{CSer}$ ..... 3.3 W; each installed C Series module consumes up to 1.1 W.

Example power requirement calculations:

- For an NI sbRIO-9642/9642XT with three installed board-only C Series modules, 20 mA total current through the 3.3 V DIO pins, and 1 A of current through the 5 V output, calculate the total power requirement as follows:

$$P_{int} = 8.00 \text{ W}$$

$$P_{CSer} = 3.30 \text{ W}$$

$$P_{DIO} = 0.08 \text{ W}$$

$$P_{5V} = 5.55 \text{ W}$$

Adding 20% for transient conditions,  $16.93 \text{ W} \times 1.2 = 20.32 \text{ W}$

Total power requirement = 20.32 W

- For an sbRIO-9612/9612XT with one installed board-only C Series module, 330 mA total current through the 3.3 V DIO pins, and no 5 V output used, calculate the total power requirement as follows:

$$P_{int} = 7.50 \text{ W}$$

$$P_{CSer} = 1.10 \text{ W}$$

$$P_{DIO} = 1.28 \text{ W}$$

$$P_{5V} = 0.00 \text{ W}$$

Adding 20% for transient conditions,  $9.88 \text{ W} \times 1.2 = 11.86 \text{ W}$

Total power requirement = 11.86 W

Backup battery .....3 V lithium coin cell,  
BR2032 (–40 to 85 °C)

## Safety Voltages

Connect only voltages that are within this limit.

V terminal to C terminal .....35 VDC max,  
Measurement Category I

Measurement Category I is for measurements performed on circuits not directly connected to the electrical distribution system referred to as *MAINS* voltage. *MAINS* is a hazardous live electrical supply system that powers equipment. This category is for measurements of voltages from specially protected secondary circuits. Such voltage measurements include signal levels, special equipment, limited-energy parts of equipment, circuits powered by regulated low-voltage sources, and electronics.



**Caution** Do not connect the system to signals or use for measurements within Measurement Categories II, III, or IV.

## Environmental Management

National Instruments is committed to designing and manufacturing products in an environmentally responsible manner. NI recognizes that eliminating certain hazardous substances from our products is beneficial to the environment and to NI customers.

For additional environmental information, refer to the *NI and the Environment* Web page at [ni.com/environment](http://ni.com/environment). This page contains the environmental regulations and directives with which NI complies, as well as other environmental information not included in this document.

## Waste Electrical and Electronic Equipment (WEEE)



**EU Customers** At the end of the product life cycle, all products *must* be sent to a WEEE recycling center. For more information about WEEE recycling centers, National Instruments WEEE initiatives, and compliance with WEEE Directive 2002/96/EC on Waste and Electronic Equipment, visit [ni.com/environment/weee](http://ni.com/environment/weee).

## Battery Replacement and Disposal



**Battery Directive** This device contains a long-life coin cell battery. If you need to replace it, use the Return Material Authorization (RMA) process or contact an authorized National Instruments service representative. For more information about compliance with the EU Battery Directive 2006/66/EC about Batteries and Accumulators and Waste Batteries and Accumulators, visit [ni.com/environment/batterydirective](http://ni.com/environment/batterydirective).

## 电子信息产品污染控制管理办法（中国 RoHS）



**中国客户** National Instruments 符合中国电子信息产品中限制使用某些有害物质指令 (RoHS)。关于 National Instruments 中国 RoHS 合规性信息，请登录 [ni.com/environment/rohs\\_china](http://ni.com/environment/rohs_china)。(For information about China RoHS compliance, go to [ni.com/environment/rohs\\_china](http://ni.com/environment/rohs_china).)

# Environmental

The NI sbRIO-96xx/96x2XT is intended for indoor use only.

Ambient temperature in enclosure  
(IEC 60068-2-1, IEC 60068-2-2)

NI sbRIO-961x/963x/964x.....-20 to 55 °C  
NI sbRIO-96x2XT .....-40 to 85 °C

Storage temperature

(IEC 60068-2-1, IEC 60068-2-2) .....-40 to 85 °C

Operating humidity

(IEC 60068-2-56) .....10 to 90% RH, noncondensing

Storage humidity (IEC 60068-2-56).....5 to 95% RH, noncondensing

Maximum altitude.....2,000 m

Pollution Degree (IEC 60664).....2

Indoor use only

# Physical Characteristics

Torque for screw terminals on J3 .....0.5 to 0.6 N · m  
(4.4 to 5.3 lb · in.)

Weight

NI sbRIO-961x/9612XT .....266.5 g (9.4 oz)

NI sbRIO-963x/9632XT .....269.3 g (9.5 oz)


NI sbRIO-964x/9642XT .....292.0 g (10.3 oz)

# Cabling

Table 6 shows the standard Ethernet cable wiring connections for both normal and crossover cables.

**Table 6.** Ethernet Cable Wiring Connections

Pin	Connector 1	Connector 2 (Normal)	Connector 2 (Crossover)
1	white/orange	white/orange	white/green
2	orange	orange	green
3	white/green	white/green	white/orange
4	blue	blue	blue
5	white/blue	white/blue	white/blue
6	green	green	orange
7	white/brown	white/brown	white/brown
8	brown	brown	brown

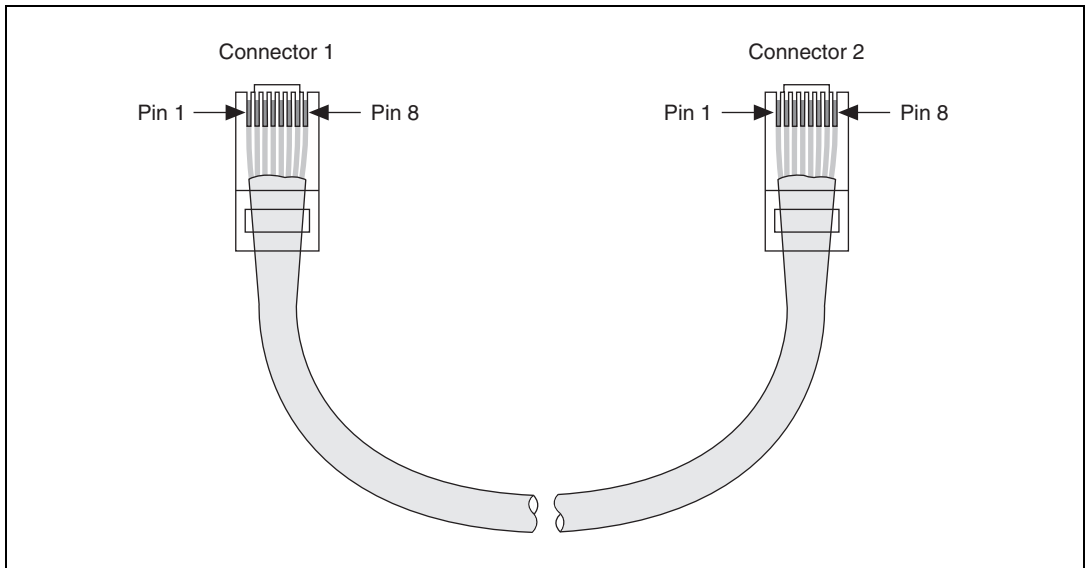

**Figure 27.** Ethernet Connector Pinout

# Where to Go for Support

---

The National Instruments Web site is your complete resource for technical support. At [ni.com/support](http://ni.com/support) you have access to everything from troubleshooting and application development self-help resources to email and phone assistance from NI Application Engineers.

National Instruments corporate headquarters is located at 11500 North Mopac Expressway, Austin, Texas, 78759-3504. National Instruments also has offices located around the world to help address your support needs. For telephone support in the United States, create your service request at [ni.com/support](http://ni.com/support) and follow the calling instructions or dial 512 795 8248. For telephone support outside the United States, contact your local branch office:

Australia 1800 300 800, Austria 43 662 457990-0,  
Belgium 32 (0) 2 757 0020, Brazil 55 11 3262 3599,  
Canada 800 433 3488, China 86 21 5050 9800,  
Czech Republic 420 224 235 774, Denmark 45 45 76 26 00,  
Finland 358 (0) 9 725 72511, France 01 57 66 24 24,  
Germany 49 89 7413130, India 91 80 41190000, Israel 972 3 6393737,  
Italy 39 02 41309277, Japan 0120-527196, Korea 82 02 3451 3400,  
Lebanon 961 (0) 1 33 28 28, Malaysia 1800 887710,  
Mexico 01 800 010 0793, Netherlands 31 (0) 348 433 466,  
New Zealand 0800 553 322, Norway 47 (0) 66 90 76 60,  
Poland 48 22 328 90 10, Portugal 351 210 311 210,  
Russia 7 495 783 6851, Singapore 1800 226 5886,  
Slovenia 386 3 425 42 00, South Africa 27 0 11 805 8197,  
Spain 34 91 640 0085, Sweden 46 (0) 8 587 895 00,  
Switzerland 41 56 2005151, Taiwan 886 02 2377 2222,  
Thailand 662 278 6777, Turkey 90 212 279 3031,  
United Kingdom 44 (0) 1635 523545

LabVIEW, National Instruments, NI, ni.com, the National Instruments corporate logo, and the Eagle logo are trademarks of National Instruments Corporation. Refer to the *Trademark Information* at [ni.com/trademarks](http://ni.com/trademarks) for other National Instruments trademarks. Other product and company names mentioned herein are trademarks or trade names of their respective companies. For patents covering National Instruments products/technology, refer to the appropriate location: **Help>Patents** in your software, the `patents.txt` file on your media, or the *National Instruments Patent Notice* at [ni.com/patents](http://ni.com/patents).